seem[®] 6 led grid ceiling FSM6L

PARTS LISTS



KEY

Preferred Light

POWER OFF





ATTENTION





CONFIGURATIONS ARE RUN SPECIFIC, PLEASE CONSULT FACTORY DRAWINGS BEFORE BEGINNING INSTALLATION.



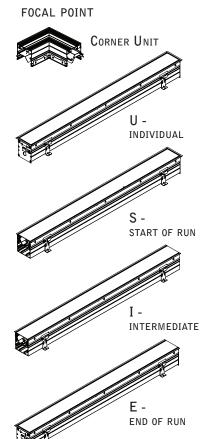






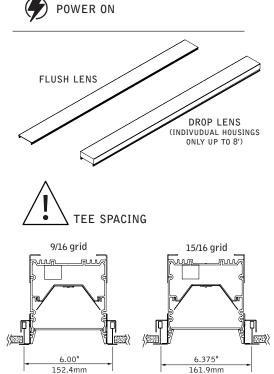





CHECK RAIL & CLIP POSITIONS BEFORE INSTALLATION. ARROWS INDICATE SCREW POSITIONS. TO CHANGE IN THE FIELD REMOVE AND REINSTALL ACCORDING TO DIAGRAMS BELOW.



G1: STD 15/16" LAY-IN TILE G2: STD 9/16" LAY-IN TILE




G4: TALL 15/16" LAY-IN TILE G5: TALL 9/16" LAY-IN TILE



G3: 9/16" SLOT-TEE TEGULAR TILE T1: STD 15/16" TEGULAR TILE


T2: STD 9/16" TEGULAR TILE T6: 9/16" NODE TEGULAR TILE



T4: TALL 15/16" TEGULAR TILE T5: TALL 9/16" TEGULAR TILE


/! STD = 1-1/2" TEE HEIGHT, TALL = 1-11/16" TEE HEIGHT


Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation). To prevent electrical shock, disconnect electrical supply before installation or servicing.

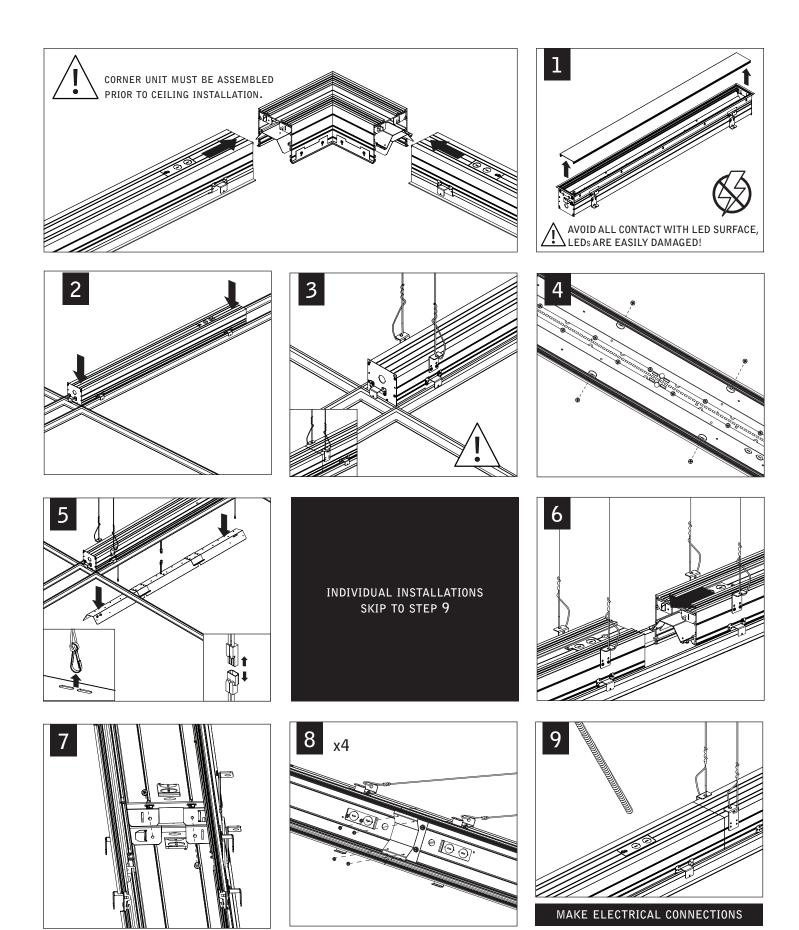



Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).


To prevent electrical shock, disconnect electrical supply before installation or servicing.














DRIVER SERVICE







EMERGENCY



SEE BATTERY MANUFACTURER INSTRUCTIONS

EMERGENCY BATTERY

MAXIMUM MOUNTING HEIGHT: 18.00'

EMERGENCY CIRCUIT


MAXIMUM MOUNTING HEIGHT: 21.00'


Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).


To prevent electrical shock, disconnect electrical supply before installation or servicing.


















WATTSTOPPER



Contractor is responsible for adequately reinforcing walls and/or ceilings to support luminaire weight. Focal Point, LLC accepts no responsibility for inadequately reinforced walls and/or ceilings. The information contained in this drawing is the sole property of Focal Point, LLC. Any reproduction in part or whole without the written permission of Focal Point, LLC is prohibited.