


**! CONFIGURATIONS ARE RUN SPECIFIC, PLEASE CONSULT FACTORY DRAWINGS BEFORE BEGINNING INSTALLATION. !**

**FOCAL POINT**

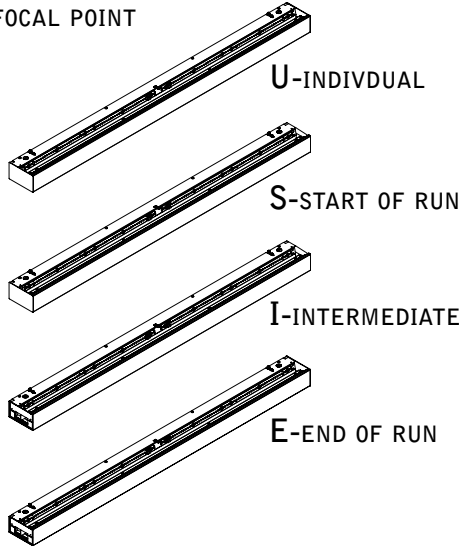


**LUMINAIRE WEIGHTS**

4' - 8LBS

8' - 19LBS

**MOUNTING RAIL & HARDWARE**

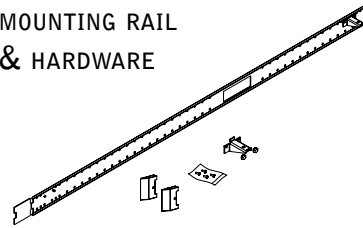

**J-BOX & WALL FASTENERS PROVIDED BY OTHERS**

**KEY**



POWER OFF



POWER ON




ATTENTION



LEVEL


**1**

**! DIMENSIONS SHOWN ARE FROM THE ROOM SIDE OBSERVING THE WALL**

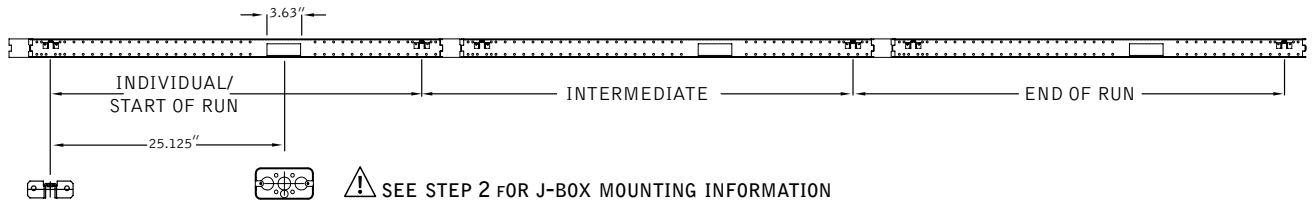

RUN LENGTH	WALL RAILS REQUIRED		
	INDIVIDUAL/START OF RUN	INTERMEDIATE(S)	END OF RUN
4'	1		
8'	2		
12'	2		1
16'	2		2
20'	2	1	2
24'	2	2	2
28'	2	4	1
32'	2	4	2


**4' HOUSING**




**! RAIL MOUNTS .45" ABOVE THE BOTTOM OF LUMINAIRE**














**6' HOUSING**








**8' HOUSING**




Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).  
To prevent electrical shock, disconnect electrical supply before installation or servicing.

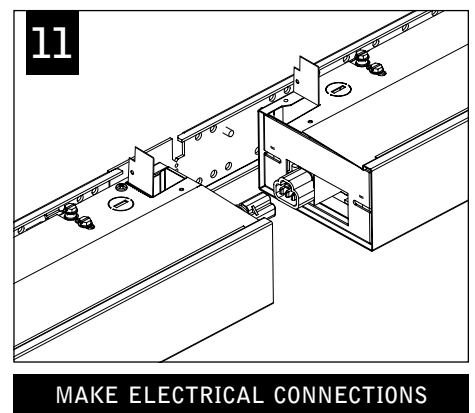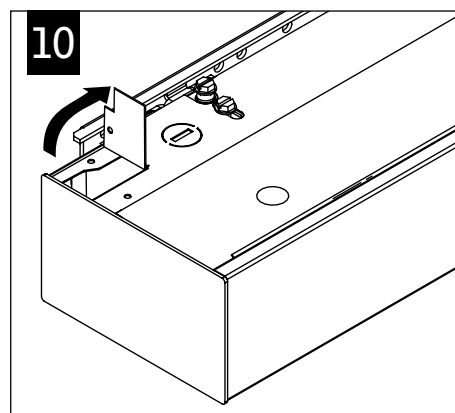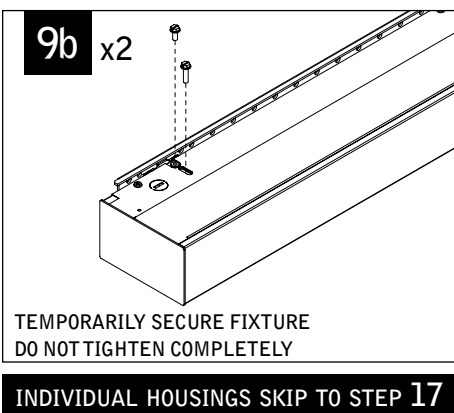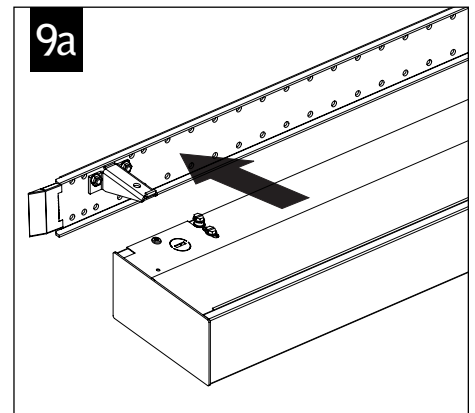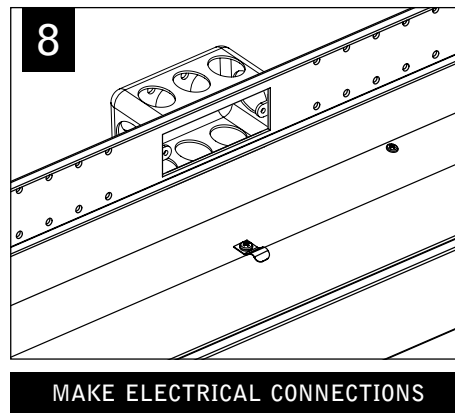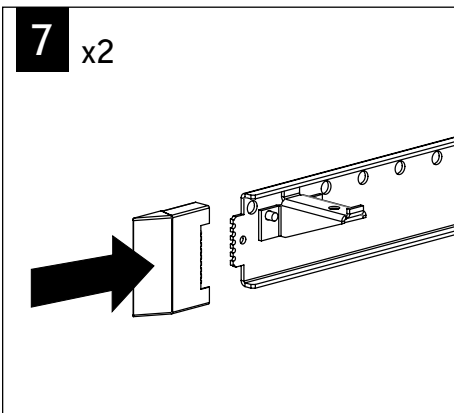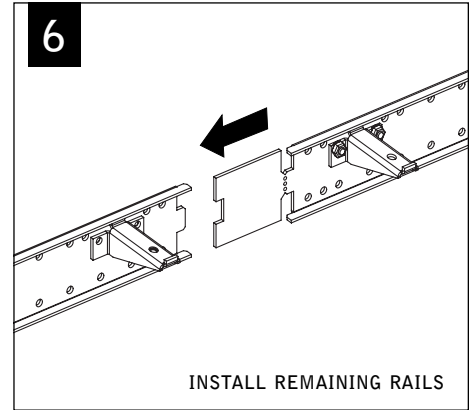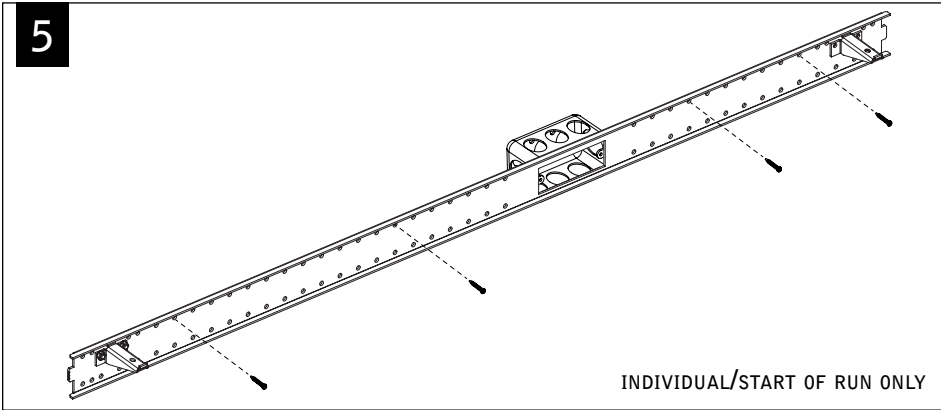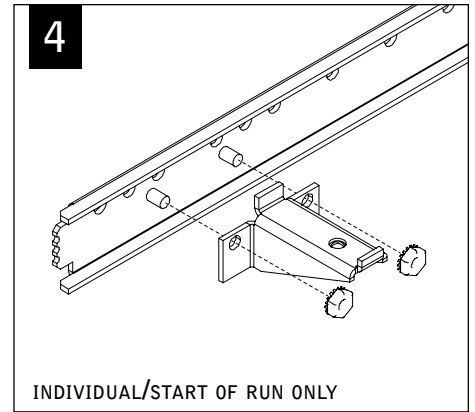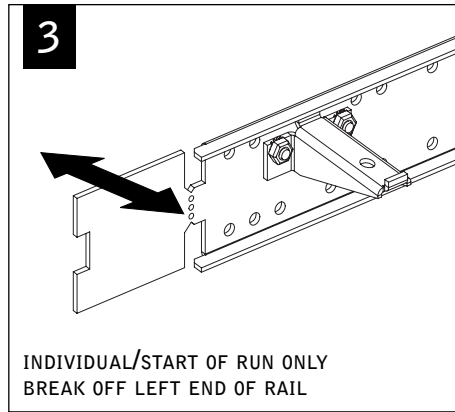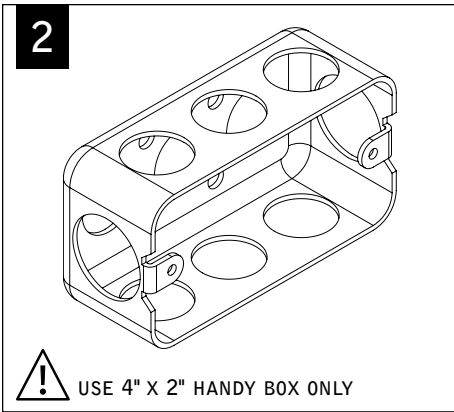



Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).  
To prevent electrical shock, disconnect electrical supply before installation or servicing.

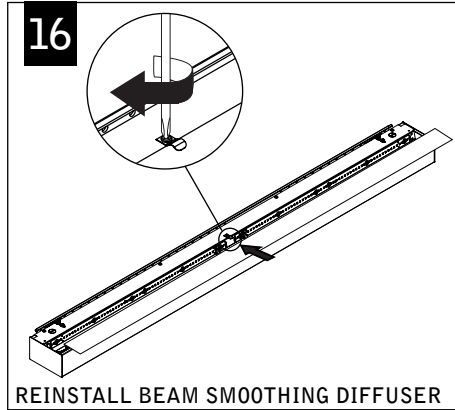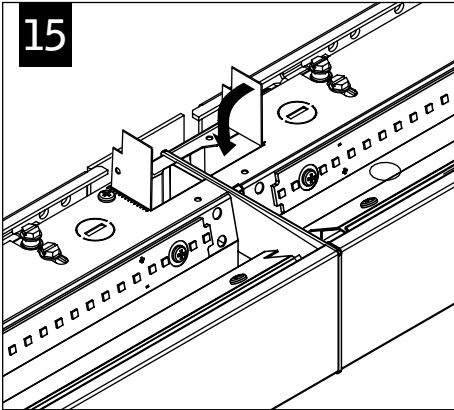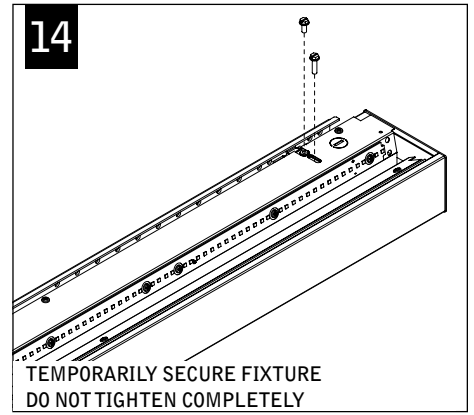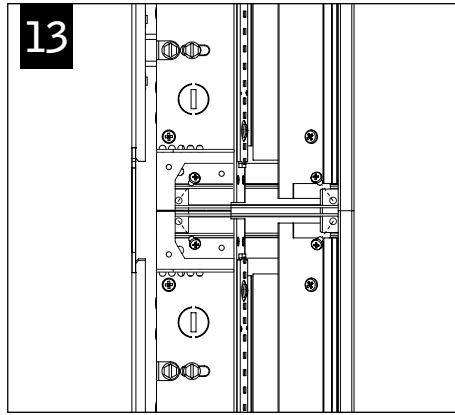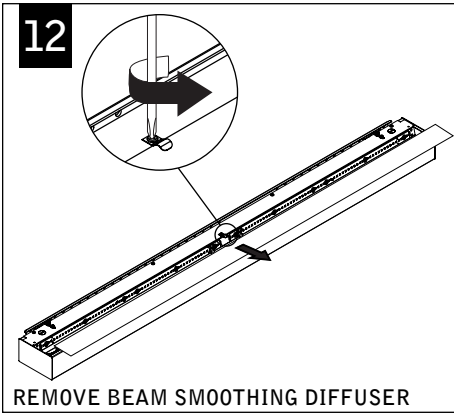

REPEAT STEPS 10-16 UNTIL  
RUN IS COMPLETE

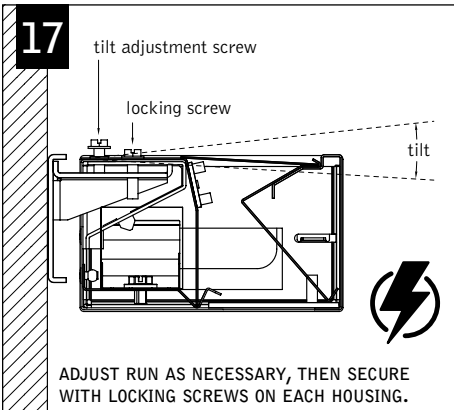

**DRIVER SERVICE**

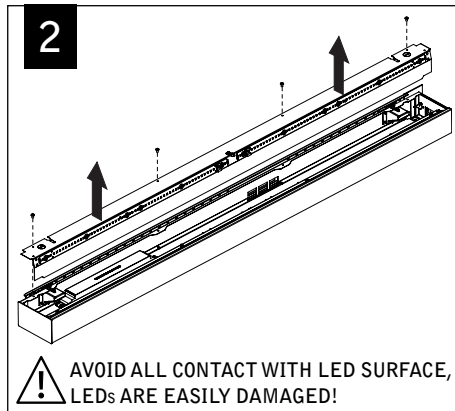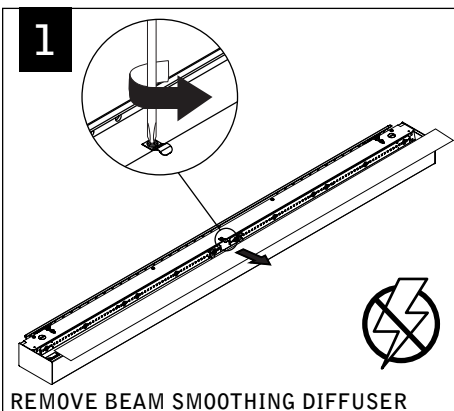

**EMERGENCY**

**I**

SEE BATTERY MANUFACTURER  
INSTRUCTIONS

EMERGENCY MAXIMUM MOUNTING HEIGHT:  
7.50'

Contractor is responsible for adequately reinforcing walls and/or ceilings to support luminaire weight. Focal Point, LLC accepts no responsibility for inadequately reinforced walls and/or ceilings. The information contained in this drawing is the sole property of Focal Point, LLC. Any reproduction in part or whole without the written permission of Focal Point, LLC is prohibited.