

SPONSOR: **Focal Point LLC**
Chicago, IL

CONDUCTED: 2023-05-15

ON: LIA Tall Height - Lit (2 rows of 2 units each, rows and units spaced 36" apart)

Sound Absorption
RAL™-A23-125

Page 1 of 9

TEST METHODOLOGY

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-23: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-23: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as LIA Tall Height - Lit (2 rows of 2 units each, rows and units spaced 36" apart). The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

Product Under Test

Product Name: LIA Tall Height
Manufacturer: Focal Point LLC

SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

Test Specimen

Materials: Felt fins radially attached to four cylindrical metal light units with felt tops
Diameter: Light units @ 641 mm (25.25 in.)
Light units with fins attached @ 889 mm (35 in.)
Depth: Light units @ 117 mm (4.625 in.)
Light units with fins attached @ 432 mm (17 in.)
Fin Thickness: 9.61 mm (0.3785 in.)
Weights: Light units @ 10.66 kg (23.5 lbs) each
Light units with fins attached @ 16.64 kg (36.69 lbs) each
Overall Weight: 66.56 kg (146.75 lbs)

Focal Point LLC
2023-05-15

RAL™-A23-125
Page 2 of 9

Physical Measurements (per object)

Dimensions: 0.89 m (35.0 in) wide by 0.89 m (35.0 in) long
Thickness: 0.43 m (17.0 in)
Weight: 16.64 kg (36.69 lbs)

Test Environment

Room Volume: 291.98 m³
Temperature: 18.9 °C ± 0.1 °C (Requirement: ≥ 10 °C and ≤ 5 °C change)
Relative Humidity: 57.7 % ± 1.0 % (Requirement: ≥ 40 % and ≤ 5 % change)
Barometric Pressure: 99.9 kPa (Requirement not defined)

MOUNTING METHOD

Type JH-MOD Mounting: The specimen is an array of 4 spaced sound absorbing objects suspended from cables such that the closest face is located approximately 775 mm (30.5 in.) from the horizontal test surface. This approximates the mounting method of a typical ceiling baffle installation. The objects were distributed in two rows of two objects each, with rows and objects in each row spaced 914 mm (36 in.) apart. The width of the installed object array was 2692 mm (106 in.) and the length of the installed object array was 2692 mm (106 in.). The area of extended continuous surface attributed to the object array was 13.0 m² (140 ft²).

Focal Point LLC
2023-05-15

RAL™-A23-125
Page 3 of 9



Figure 1 – Specimen mounted in test chamber



Figure 2 – Specimen mounted in test chamber

Focal Point LLC
2023-05-15

RAL™-A23-125
Page 4 of 9



Figure 3 – Individual specimen light unit prior to installation of felt fins around perimeter

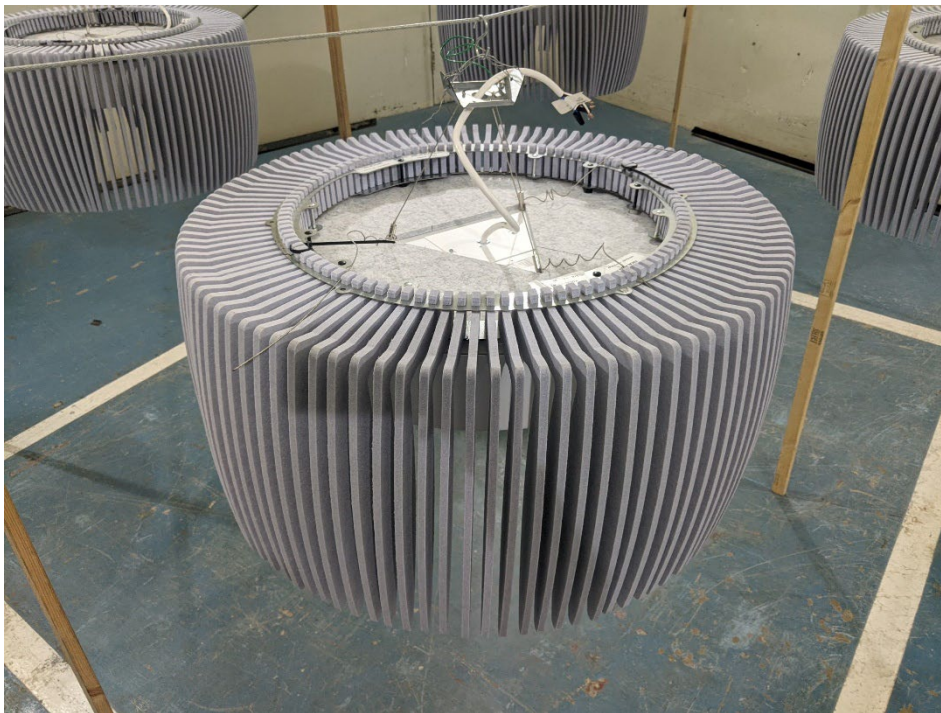


Figure 4 – Individual specimen light unit with felt fins installed

Focal Point LLC
2023-05-15

RAL™-A23-125
Page 5 of 9

TEST RESULTS

The preferred presentation of sound absorption test results for arrays of spaced objects is sound absorption (m^2) per object and total sound absorption (m^2) at each one-third-octave band

ASTM C423-23 Appendix X2 allows calculation of sound absorption per m^2 (SA/m^2) based on the projected horizontal surface area attributable to an array of objects. The extended continuous surface area used in this calculation is to be determined the following procedure:

$S_{array} = (w + w_1) \times (l + l_1)$ If the set of objects consists of a rectangular array of equal sized objects with equal space between each object in a row and equal space between rows. (ASTM E423-23 X.2.3.1)

Where:

S_{array} = area of extended continuous surface attributed to the test specimen, m^2
 w = the measured width of the installed object array, in meters
 w_1 = the space between objects in the array along the width, in meters
 l = the measured length of the installed object array, in meters
 l_1 = the space between objects in the array along the length, in meters

The sound absorption per m^2 (SA/m^2) is calculated based on the following formula:

$$\alpha_{array} = (A_2 - A_1)/S_{array}$$

Where:

α_{array} = sound absorption per m^2 (SA/m^2) of extended continuous surface, no units,
 A_1 = absorption of the empty reverberation room, m^2 and
 A_2 = absorption of the room after the specimen has been installed, m^2 .
 S_{array} = area of extended continuous surface attributed to the test specimen, m^2

Focal Point LLC
2023-05-15

RAL™-A23-125
Page 6 of 9

TEST RESULTS (continued)


1/3 Octave Center Frequency (Hz)	Total Absorption		Absorption per Object		α_{array} (Sabins/ft ²) (SA/m ²)
	(m ²)	(Sabins)	(m ² / Object)	(Sabins / Object)	
100	0.68	7.27	0.17	1.82	0.05
** 125	1.18	12.71	0.30	3.18	0.09
160	1.49	16.05	0.37	4.01	0.11
200	0.71	7.62	0.18	1.91	0.05
** 250	0.64	6.86	0.16	1.71	0.05
315	1.03	11.04	0.26	2.76	0.08
400	1.37	14.79	0.34	3.70	0.11
** 500	1.68	18.09	0.42	4.52	0.13
630	2.35	25.28	0.59	6.32	0.18
800	3.42	36.84	0.86	9.21	0.26
** 1000	4.58	49.34	1.15	12.33	0.35
1250	5.61	60.38	1.40	15.10	0.43
1600	6.40	68.88	1.60	17.22	0.49
** 2000	6.86	73.84	1.71	18.46	0.53
2500	7.23	77.85	1.81	19.46	0.56
3150	7.55	81.22	1.89	20.30	0.58
** 4000	7.70	82.83	1.92	20.71	0.59
5000	8.05	86.70	2.01	21.68	0.62

Array-NRC 0.25 over 13.0 m² of extended continuous surface area

Array-SAA 0.27 over 13.0 m² of extended continuous surface area

Tested by 
Marc Sciaky
Senior Experimentalist


Report by 
Keith Kimberling
Test Engineer

Approved by 
Eric P. Wolfram
Laboratory Manager

Note: Sound absorption per m² (SA/m²), and therefore the reported Single Number Ratings, are highly dependent on the exact sample shape, size, spacing, and extended continuous surface area present in the test and subsequent calculations. Changes to any of these parameters will change the resulting values. These presented results are valid only for the specific configuration present in this test.

SOUND ABSORPTION REPORT

LIA Tall Height - Lit (2 rows of 2 units each, rows and units spaced 36" apart)

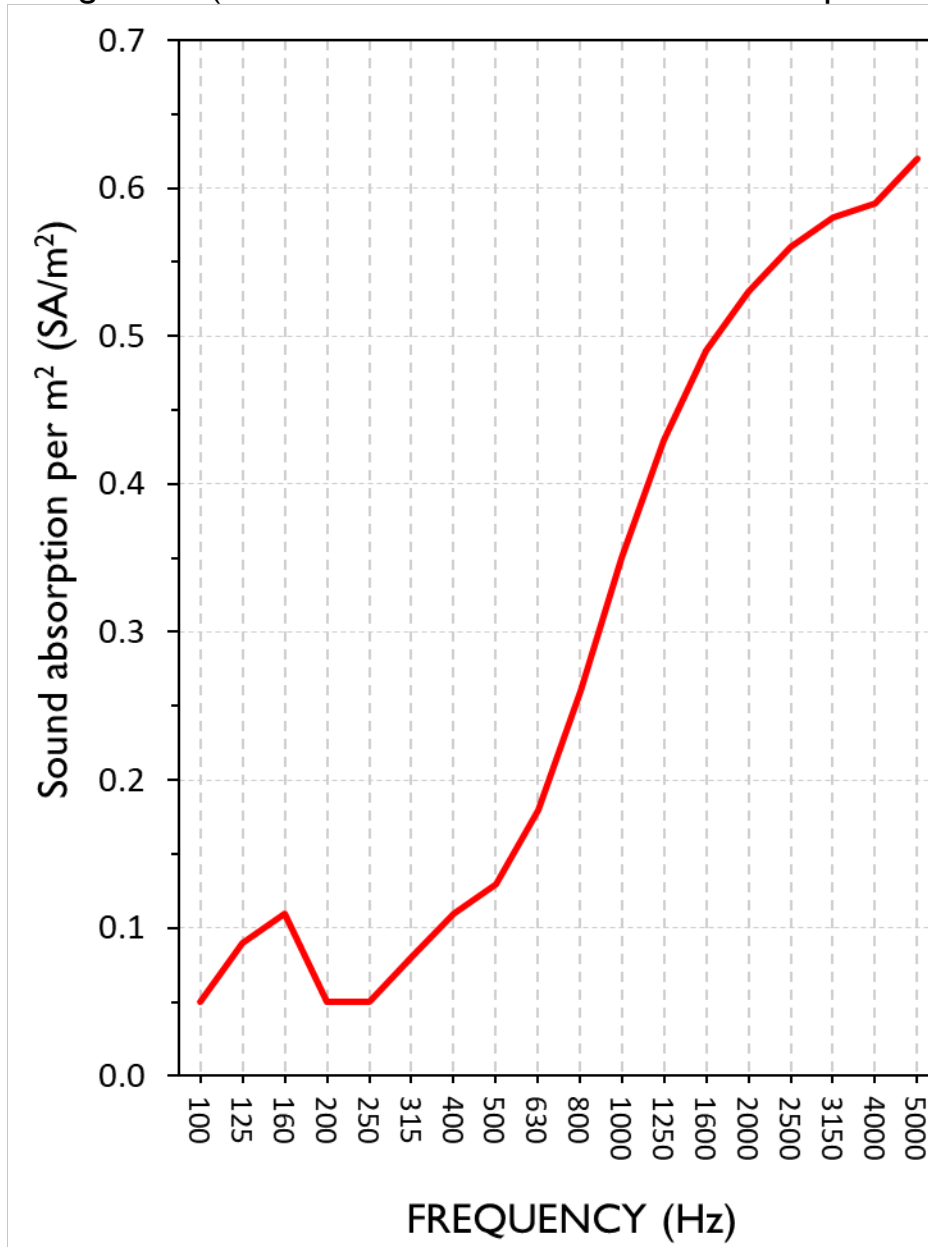

Array-NRC 0.25 over 13.0 m² of extended continuous surface area
Array-SAA 0.27 over 13.0 m² of extended continuous surface area



Focal Point LLC
2023-05-15

RAL™-A23-125
Page 8 of 9

APPENDIX A: Extended Frequency Range Data

Specimen: LIA Tall Height - Lit (2 rows of 2 units each, rows and units spaced 36" apart) (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-23, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency (Hz)	Total Absorption		Absorption per Object		α_{array} (Sabins/ft ²)
	(m ²)	(Sabins)	(m ² / Object)	(Sabins / Object)	(SA/m ²)
31.5	0.60	6.49	0.15	1.62	0.05
40	0.49	5.31	0.12	1.33	0.04
50	0.19	2.00	0.05	0.50	0.01
63	0.88	9.51	0.22	2.38	0.07
80	0.33	3.56	0.08	0.89	0.03
100	0.68	7.27	0.17	1.82	0.05
125	1.18	12.71	0.30	3.18	0.09
160	1.49	16.05	0.37	4.01	0.11
200	0.71	7.62	0.18	1.91	0.05
250	0.64	6.86	0.16	1.71	0.05
315	1.03	11.04	0.26	2.76	0.08
400	1.37	14.79	0.34	3.70	0.11
500	1.68	18.09	0.42	4.52	0.13
630	2.35	25.28	0.59	6.32	0.18
800	3.42	36.84	0.86	9.21	0.26
1000	4.58	49.34	1.15	12.33	0.35
1250	5.61	60.38	1.40	15.10	0.43
1600	6.40	68.88	1.60	17.22	0.49
2000	6.86	73.84	1.71	18.46	0.53
2500	7.23	77.85	1.81	19.46	0.56
3150	7.55	81.22	1.89	20.30	0.58
4000	7.70	82.83	1.92	20.71	0.59
5000	8.05	86.70	2.01	21.68	0.62
6300	8.16	87.79	2.04	21.95	0.63
8000	8.10	87.15	2.02	21.79	0.62
10000	8.04	86.55	2.01	21.64	0.62
12500	7.67	82.53	1.92	20.63	0.59



1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Focal Point LLC
2023-05-15

RAL™-A23-125
Page 9 of 9

APPENDIX B: Instruments of Traceability

Specimen: LIA Tall Height - Lit (2 rows of 2 units each, rows and units spaced 36" apart) (See Full Report)

<u>Description</u>	<u>Model</u>	<u>Serial Number</u>	<u>Date of Certification</u>	<u>Calibration Due</u>
System 1	Type 3160-A-042	3160-106968	2022-07-12	2023-07-12
Bruel & Kjaer Mic And Preamp D	Type 4943-B-001	2311440	2022-09-28	2023-09-28
Bruel & Kjaer Pistonphone	Type 4228	2781248	2022-07-22	2023-07-22
EXTECH Hygro 639	SD700	A.103639	2022-12-07	2023-12-07

APPENDIX C: Revisions to Original Test Report

Specimen: LIA Tall Height - Lit (2 rows of 2 units each, rows and units spaced 36" apart) (See Full Report)

<u>Date</u>	<u>Revision</u>
2023-05-16	Original report issued

END



NVLAP LAB CODE 100227-0

RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.