627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

SPONSOR: Focal Point

Chicago, IL

Sound Absorption RALTM-A25-156

CONDUCTED: 2025-03-25

Page 1 of 9

ON: Plyta 24" (21 objects, 7 rows of 3 objects each, rows spaced 3" apart, objects in rows spaced 3"

apart)

TEST METHODOLOGY

Riverbank Acoustical LaboratoriesTM is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-23: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-23: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as Plyta 24" (21 objects, 7 rows of 3 objects each, rows spaced 3" apart, objects in rows spaced 3" apart). The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

Product Under Test

Product Name: Plyta 24"

Manufacturer: Focal Point

SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

Test Specimen

Product Type: PET felt disc baffles

Dimensions: 21 objects @ 533 mm (21 in.) diameter

Thickness: 18.73 mm (0.7375 in.)

Overall Weight: 20.41 kg (45 lbs)



627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

RALTM-A25-156 Page 2 of 9

Focal Point 2025-03-25

SPECIMEN MEASUREMENTS & TEST CONDITIONS (continued)

Physical Measurements (per object)

Dimensions: 0.53 m (21.0 in) wide by 0.53 m (21.0 in) long

Thickness: 0.02 m (0.7375 in) Weight: 0.91 kg (2.0 lbs)

Test Environment

Room Volume: 291.98 m³

Temperature: $21.5 \text{ °C} \pm 0.1 \text{ °C}$ (Requirement: $\geq 10 \text{ °C}$ and $\leq 5 \text{ °C}$ change) Relative Humidity: $56.95 \% \pm 1.9 \%$ (Requirement: $\geq 40 \%$ and $\leq 5 \%$ change)

Barometric Pressure: 98.8 kPa (Requirement not defined)

Each sound absorbing object had an exposed surface area of 0.478 m² (5.15 ft²). The total exposed surface area of all sound-absorbing objects was 10.0 m² (108 ft²).

MOUNTING METHOD

Type JH-MOD Mounting: The specimen is an array of 21 spaced sound absorbing objects suspended from cables such that the closest face is located approximately 1422 mm (56 in.) from the horizontal test surface. This approximates the mounting method of a typical ceiling baffle installation. The objects were distributed in seven rows of three objects each, with rows spaced 76 mm (3 in.) apart, and objects in each row spaced 76 mm (3 in.) apart. The width of the installed object array was 1753 mm (69 in.) and the length of the installed object array was 4191 mm (165 in.). The area of extended continuous surface attributed to the object array was 7.80 m² (84 ft²).



627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

RALTM-A25-156 Page 3 of 9

Focal Point 2025-03-25



Figure 1 – Specimen mounted in test chamber



Figure 2 – Specimen mounted in test chamber



RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

TESTING THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE NVLAP LAB CODE 100227-0 SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report


www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

RALTM-A25-156 Page 4 of 9

Focal Point 2025-03-25







627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

RALTM-A25-156 Page 5 of 9

Focal Point 2025-03-25

TEST RESULTS

The preferred presentation of sound absorption test results for arrays of spaced objects is sound absorption (m²) per object and total sound absorption (m²) at each one-third-octave band

ASTM C423-23 Appendix X2 allows calculation of sound absorption per m² (SA/m²) based on the projected horizontal surface area attributable to an array of objects. The extended continuous surface area used in this calculation is to be determined using the following procedure:

 $S_{array} = (w + w_1) \times (l + l_1)$ If the set of objects consists of a rectangular array of equal sized objects with equal space between each object in a row and equal space between rows. (ASTM E423-23 X.2.3.1)

Where:

 S_{array} = area of extended continuous surface attributed to the test specimen, m² w = the measured width of the installed object array, in meters w_I = the space between objects in the array along the width, in meters l = the measured length of the installed object array, in meters l_I = the space between objects in the array along the length, in meters

The sound absorption per m² (SA/m²) is calculated based on the following formula:

$$\alpha_{array} = (A_2 - A_1)/S_{array}$$

Where:

 α_{array} = sound absorption per m² (SA/m²) of extended continuous surface, no units,

 A_1 = absorption of the empty reverberation room, m^2 and

 A_2 = absorption of the room after the specimen has been installed, m^2 .

 S_{array} = area of extended continuous surface attributed to the test specimen, m^2



TESTING UTHIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE NVLAP LAB CODE 100227-0 SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

RALTM-A25-156 Page 6 of 9

Focal Point 2025-03-25

TEST RESULTS (continued)

1/3 Octave Center Frequency	Total Absorption		Absorptio	α _{array} (Sabins/ft²)	
(Hz)	(m^2)	(Sabins)	(m ² /Object)	(Sabins / Object)	(SA/m^2)
100	0.93	9.98	0.04	0.48	0.12
** 125	0.46	4.93	0.02	0.23	0.06
160	0.72	7.70	0.03	0.37	0.09
200	1.58	17.02	0.08	0.81	0.20
** 250	2.10	22.57	0.10	1.07	0.27
315	3.26	35.12	0.16	1.67	0.42
400	3.63	39.06	0.17	1.86	0.46
** 500	4.37	47.02	0.21	2.24	0.56
630	5.11	54.95	0.24	2.62	0.65
800	5.71	61.49	0.27	2.93	0.73
** 1000	6.57	70.75	0.31	3.37	0.84
1250	7.41	79.78	0.35	3.80	0.95
1600	8.19	88.14	0.39	4.20	1.05
** 2000	8.71	93.80	0.41	4.47	1.12
2500	9.21	99.09	0.44	4.72	1.18
3150	9.52	102.42	0.45	4.88	1.22
** 4000	9.79	105.35	0.47	5.02	1.25
5000	9.99	107.55	0.48	5.12	1.28

Array-NRC 0.70 over 7.80 m² of extended continuous surface area **Array-SAA 0.70** over 7.80 m² of extended continuous surface area

Tested by //acc Sciaky

Senior Experimentalist

Report by

Keith Kimberling

Test Engineer

Approved by

/Eric P. Wolfram Laboratory Manager

Note: Sound absorption per m^2 (SA/m^2), and therefore the reported Single Number Ratings, are highly dependent on the exact sample shape, size, spacing, and extended continuous surface area present in the test and subsequent calculations. Changes to any of these parameters will change the resulting values. These presented results are valid only for the specific configuration present in this test.

NVLAP® TESTING

®RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com


FOUNDED 1918 BY WALLACE CLEMENT SABINE

RALTM-A25-156 Page 7 of 9

Focal Point 2025-03-25

SOUND ABSORPTION REPORT

Plyta 24" (21 objects, 7 rows of 3 objects each, rows spaced 3" apart, objects in rows spaced 3" apart)

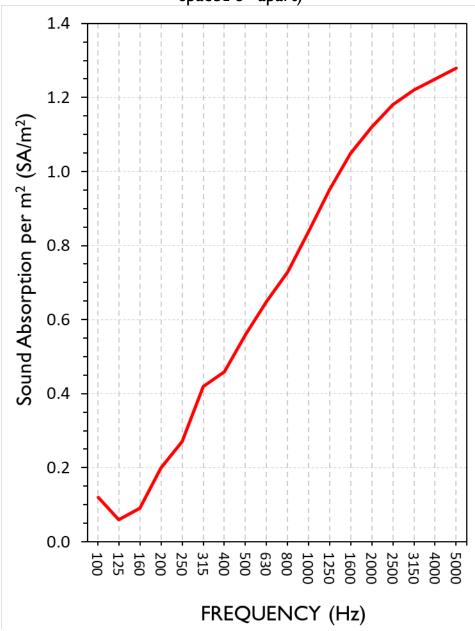

Array-NRC 0.70 over 7.80 m² of extended continuous surface area **Array-SAA 0.70** over 7.80 m² of extended continuous surface area

NV LADOR OF LOSSES

RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

Focal Point 2025-03-25

RALTM-A25-156 Page 8 of 9

APPENDIX A: Extended Frequency Range Data

Specimen: Plyta 24" (21 objects, 7 rows of 3 objects each, rows spaced 3" apart, objects in rows spaced 3" apart) (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-23, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency	Total Absorption		Absorption	α_{array} (Sabins/ft ²)	
(Hz)	(m^2)	(Sabins)	(m ² /Object)	(Sabins / Object)	(SA/m^2)
31.5	-0.09	-1.00	0.00	-0.05	-0.01
40	0.20	2.15	0.01	0.10	0.03
50	-0.92	-9.87	-0.04	-0.47	-0.12
63	0.24	2.60	0.01	0.12	0.03
80	1.08	11.64	0.05	0.55	0.14
100	0.93	9.98	0.04	0.48	0.12
125	0.46	4.93	0.02	0.23	0.06
160	0.72	7.70	0.03	0.37	0.09
200	1.58	17.02	0.08	0.81	0.20
250	2.10	22.57	0.10	1.07	0.27
315	3.26	35.12	0.16	1.67	0.42
400	3.63	39.06	0.17	1.86	0.46
500	4.37	47.02	0.21	2.24	0.56
630	5.11	54.95	0.24	2.62	0.65
800	5.71	61.49	0.27	2.93	0.73
1000	6.57	70.75	0.31	3.37	0.84
1250	7.41	79.78	0.35	3.80	0.95
1600	8.19	88.14	0.39	4.20	1.05
2000	8.71	93.80	0.41	4.47	1.12
2500	9.21	99.09	0.44	4.72	1.18
3150	9.52	102.42	0.45	4.88	1.22
4000	9.79	105.35	0.47	5.02	1.25
5000	9.99	107.55	0.48	5.12	1.28
6300	10.41	112.10	0.50	5.34	1.33
8000	10.31	110.97	0.49	5.28	1.32
10000	10.29	110.81	0.49	5.28	1.32
12500	10.45	112.48	0.50	5.36	1.34



®RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

Focal Point 2025-03-25

RALTM-A25-156 Page 9 of 9

APPENDIX B: Instruments of Traceability

Specimen: Plyta 24" (21 objects, 7 rows of 3 objects each, rows spaced 3" apart, objects in rows spaced 3" apart) (See Full Report)

		Serial	Date of	Calibration
Description	Model	Number	Certification	<u>Due</u>
System 1	Type 3160-A-042	3160- 106974	2024-08-15	2025-08-15
Bruel & Kjaer Mic And Preamp G	Type 4943-B-001	2525858	2024-05-07	2025-05-07
Bruel & Kjaer Pistonphone	Type 4228	2781248	2024-07-19	2025-07-19
EXTECH Hygro 959	SD700	A099959	2024-03-29	2025-03-29

APPENDIX C: Revisions to Original Test Report

Specimen: Plyta 24" (21 objects, 7 rows of 3 objects each, rows spaced 3" apart, objects in rows spaced 3" apart) (See Full Report)

<u>Date</u> <u>Revision</u>

2025-03-31 Original report issued

END

