

Seem® 1 Acoustic Trio

ASM1TP | ASM1TBP | ASM1TIP | AUSM1TP

AirCore Technology™



FOCAL POINT®

BEFORE YOU BEGIN


- Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
- To prevent electrical shock, disconnect electrical supply before installation or servicing.
- Contractor is responsible for adequately reinforcing walls and/or ceilings to support fixture weight.
- Focal Point, LLC accepts no responsibility for inadequately reinforced walls and/or ceilings.
- The information contained in this drawing is the sole property of Focal Point, LLC. Any reproduction in part or whole without the written permission of Focal Point, LLC is prohibited.

INSTRUCTION KEY


- ATTENTION**
- SEE ADDITIONAL INSTRUCTIONS**
- POWER OFF**
- POWER ON**

COMPONENT KEY

FOCAL POINT

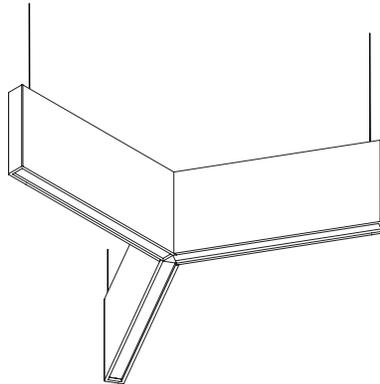

Direct | Direct/Indirect

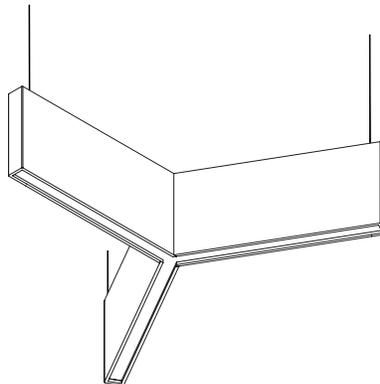

Indirect | Unlit

PARTS LIST

- | | |
|--|--------------------------------------|
| <p>Jack Screw (700168)
(10-32 x 1 MACHINE SCREW)
QTY 1</p> | <p>Cable Gripper
(700226-01)</p> |
| <p>Joiner Plate/Access Plate
Screw (72026)
(6-20 x 1/4 SELF TAPPING SCREW)
QTY 9</p> | <p>Center Cover</p> |
| <p>Joiner Core</p> | <p>Joiner Plate</p> |
| | <p>Access Plate</p> |


**ASSEMBLE ON A FLAT SURFACE
TO ENSURE PROPER ALIGNMENT**

**FOR DIFFERENT CEILING
INSTALLATIONS SEE PAGES 4-5**


7.5"
Minimum mounting
distance from ceiling*



*Direct/Indirect & Indirect
only illuminated baffles

MOUNTING DIMENSIONS


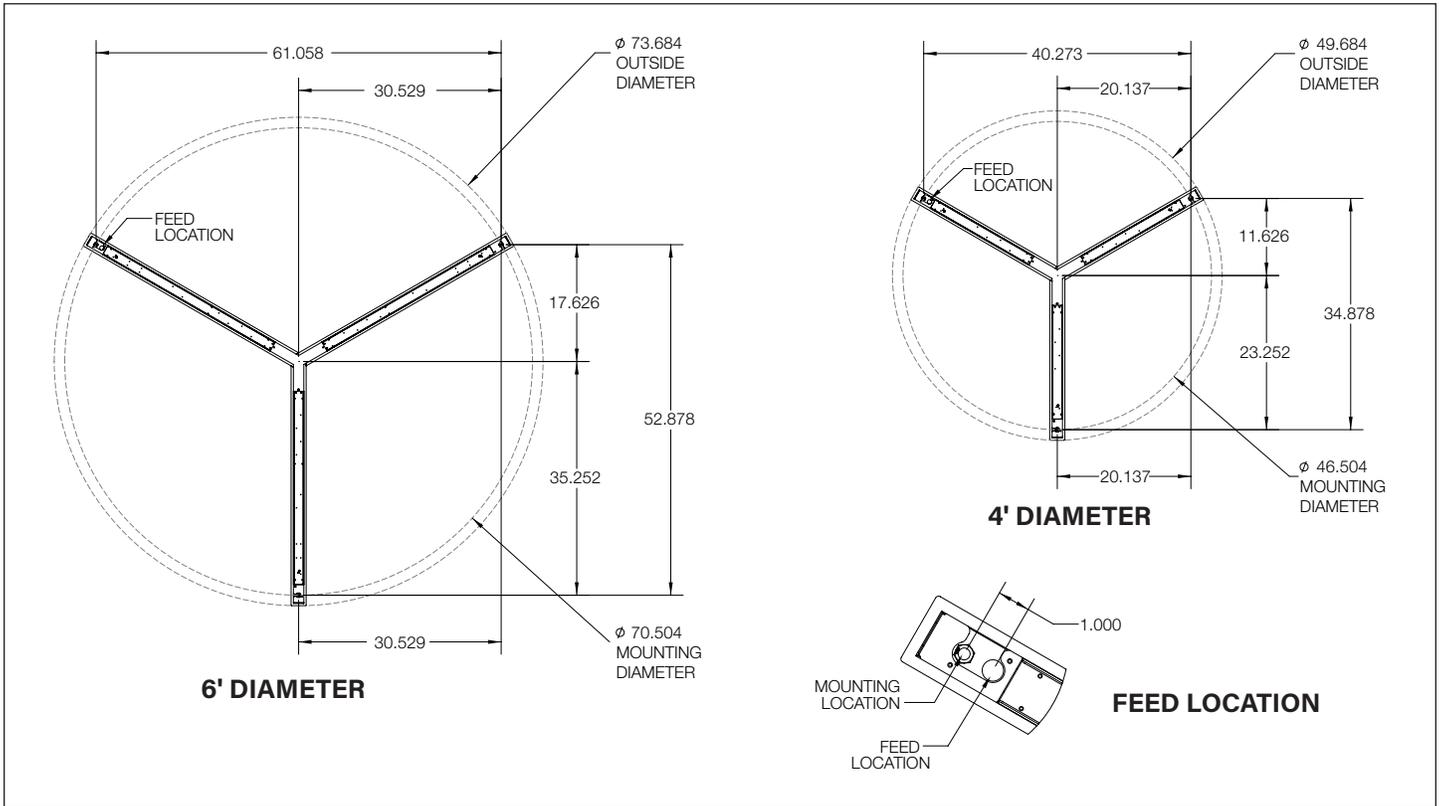


BASIC INSTALLATION



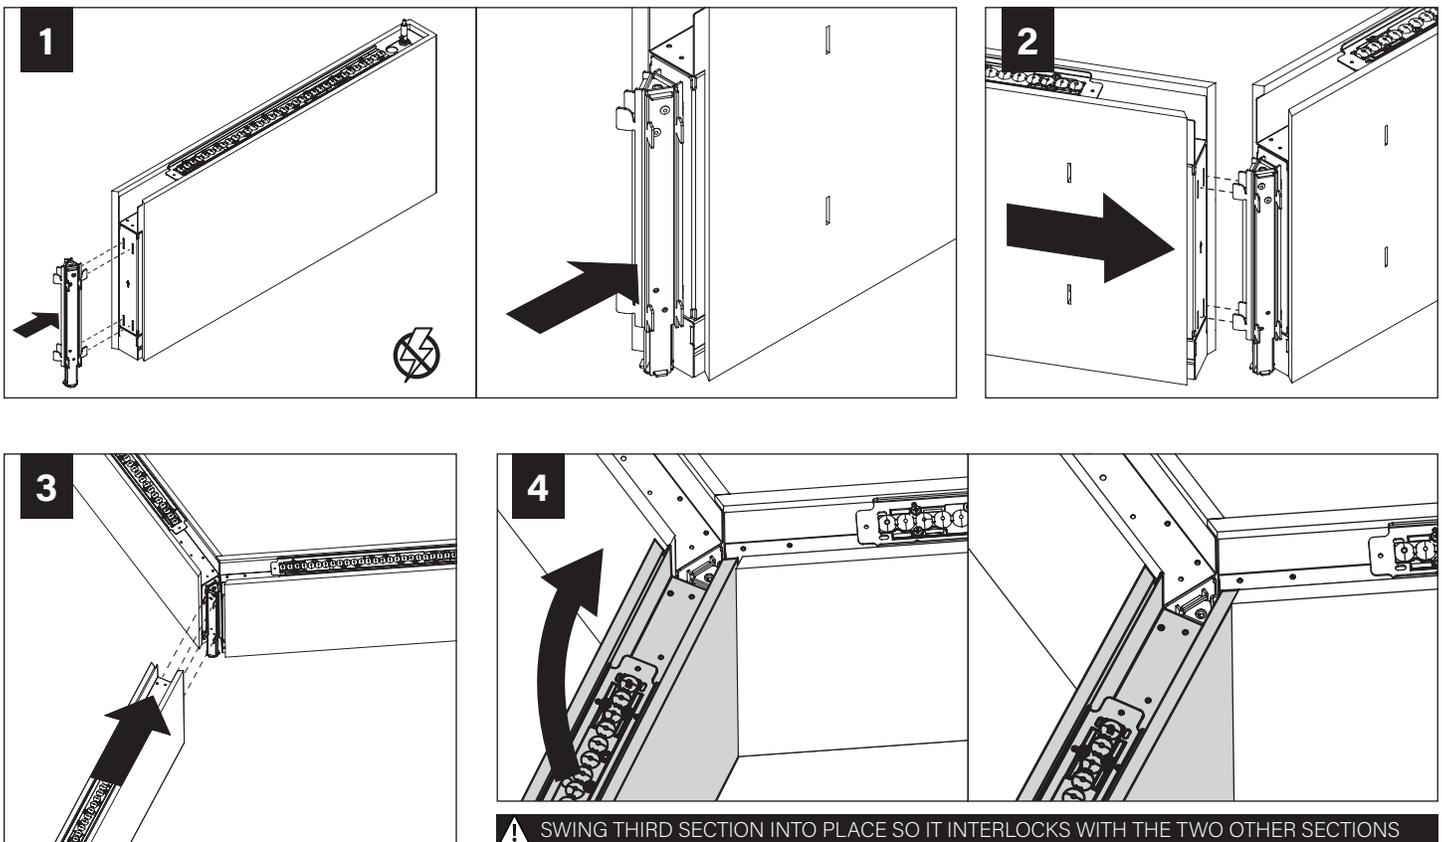


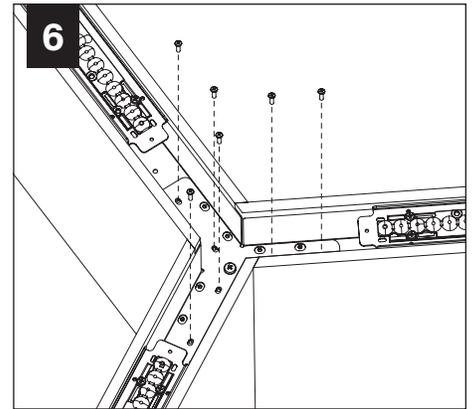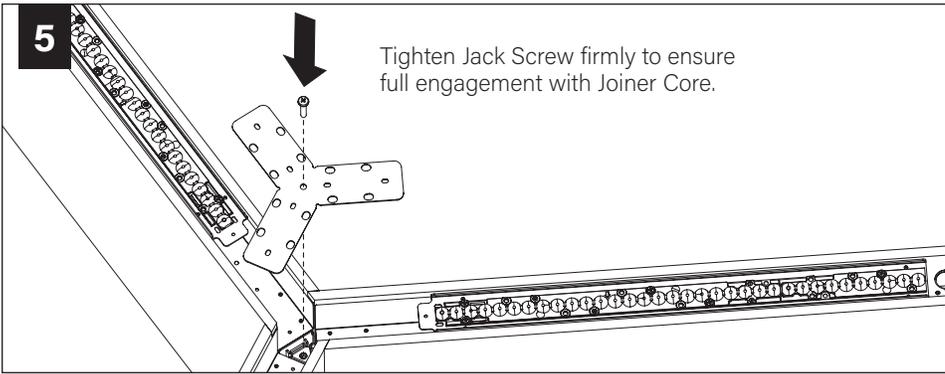


⚠ DO NOT PINCH WIRES BENEATH PLATE.


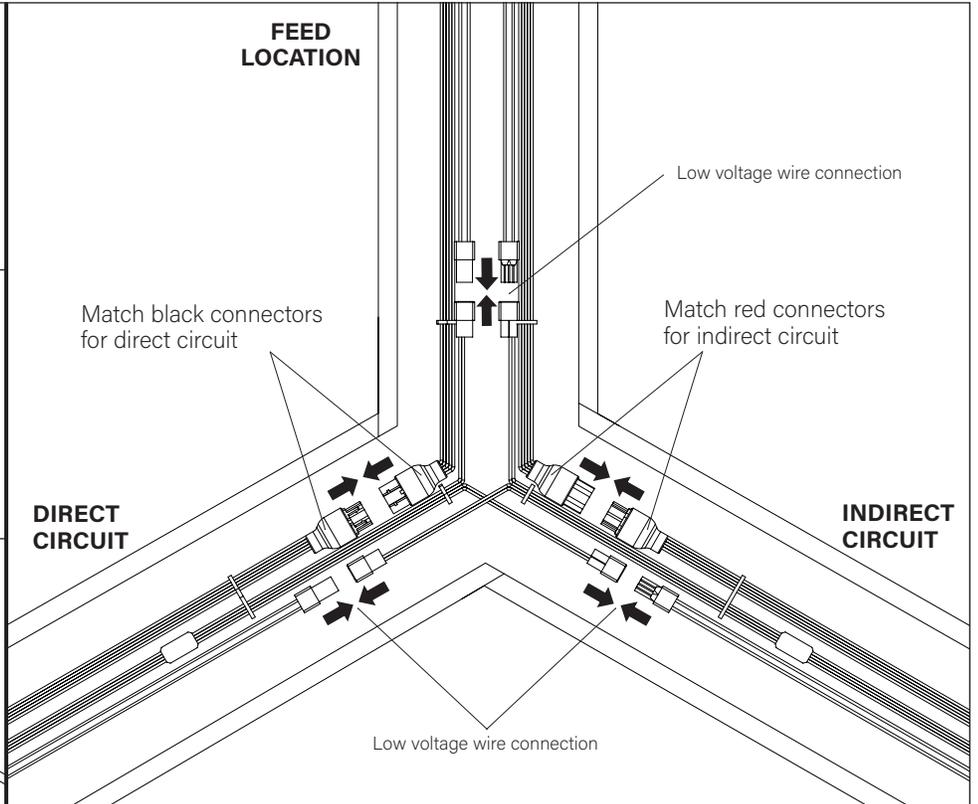
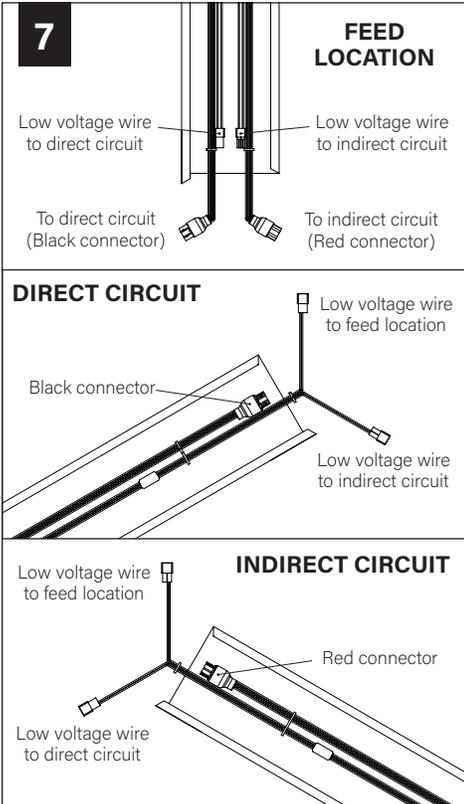


MAKE ELECTRICAL CONNECTIONS


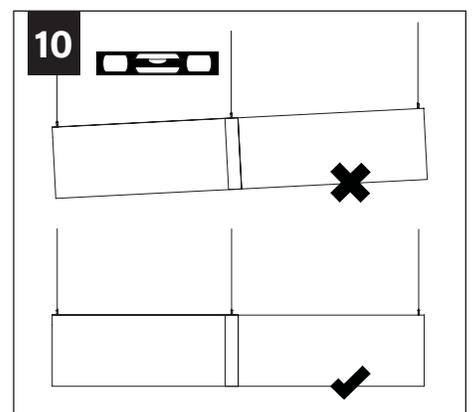
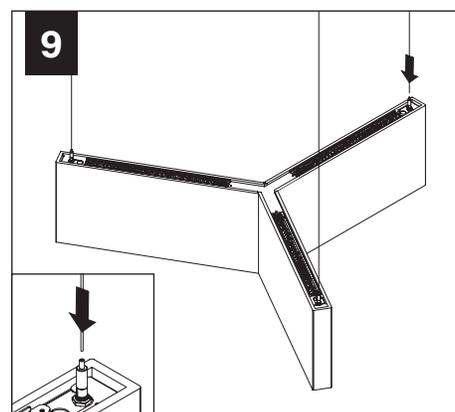
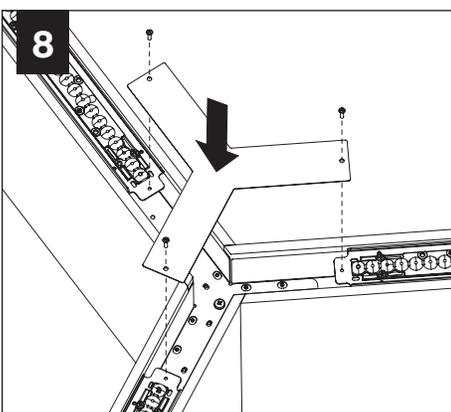


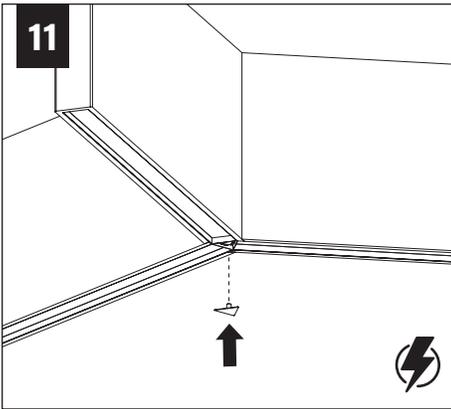

DRIVER SERVICE

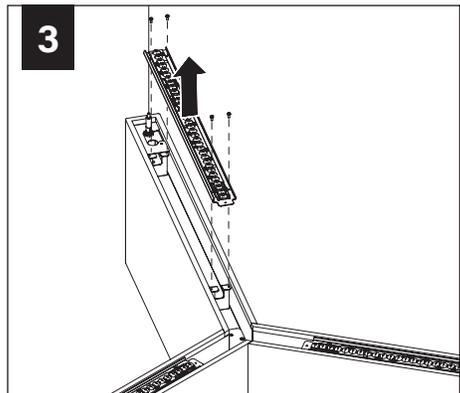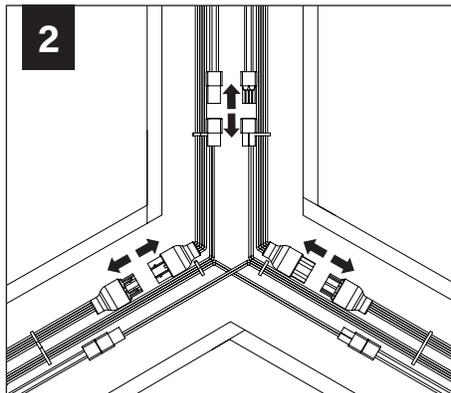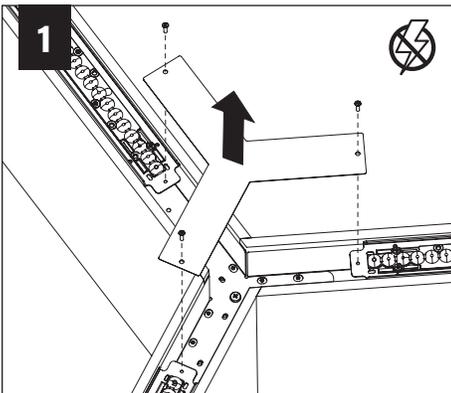

CEILING STRUT INSTALLATION

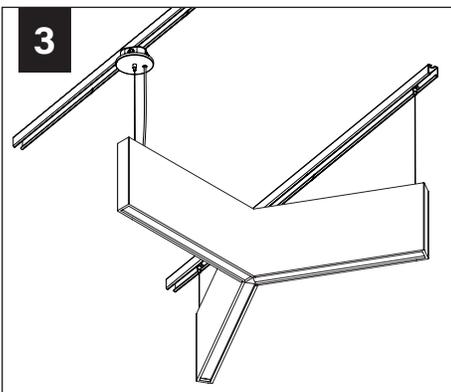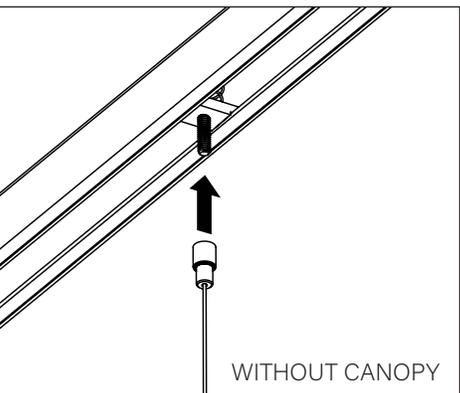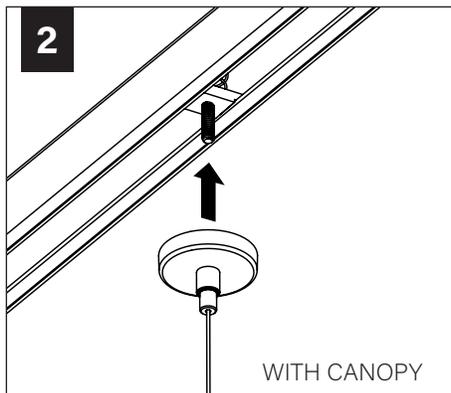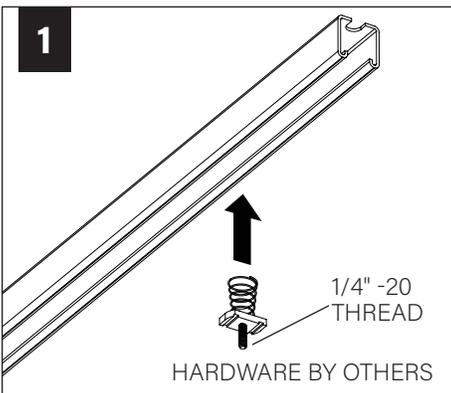

DRYWALL/HARD SURFACE CEILING INSTALLATION

