

ID⁺ 2.5" Pure Cylinder - Stem Mount

FLCY2N-RD-5H | FLCY2N-RD-8H | FLCY2N-RD-12H- Mini Power Canopy



FOCAL POINT®



BEFORE YOU BEGIN

- Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
- To prevent electrical shock, disconnect electrical supply before installation or servicing.
- Contractor is responsible for adequately reinforcing walls and/or ceilings to support fixture weight.
- Focal Point, LLC accepts no responsibility for inadequately reinforced walls and/or ceilings.
- The information contained in this drawing is the sole property of Focal Point, LLC. Any reproduction in part or whole without the written permission of Focal Point, LLC is prohibited.

INSTRUCTION KEY



ATTENTION



SEE ADDITIONAL INSTRUCTIONS



POWER OFF




POWER ON

COMPONENT KEY

STEM MOUNT


Shipped Assembled

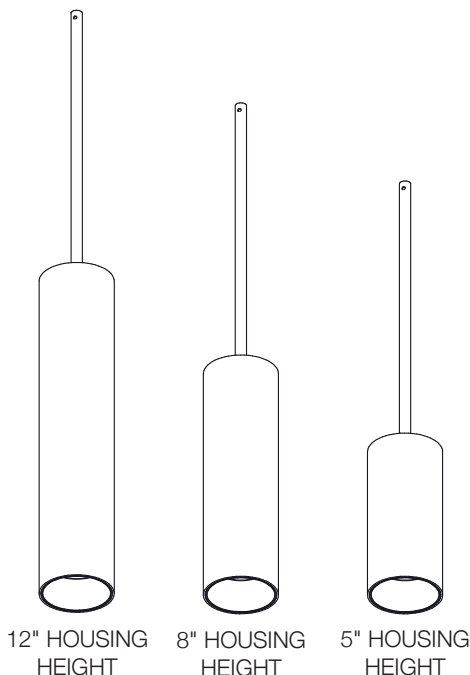


MINI POWER CANOPY




FINISHING RING



J-BOX MOUNTING BRACKET / DRIVER CARRIAGE



MINI POWER CANOPY



STEM MOUNTING BRACKET



FACE PLATE


SHIPPED INSTALLED



#8-32X5/16" HALF DOG NOSE SET SCREWS

4" OCTAGONAL J-BOX REQUIRED

J-BOX BY OTHERS











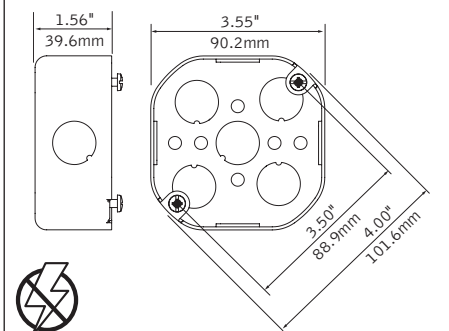














EMERGENCY



PRIOR TO LUMINAIRE INSTALLATION, SEE **PAGE 5** FOR EMERGENCY INSTALLATION INSTRUCTIONS.

FIELD CUTTABLE FIXED STEM (OPTIONAL)

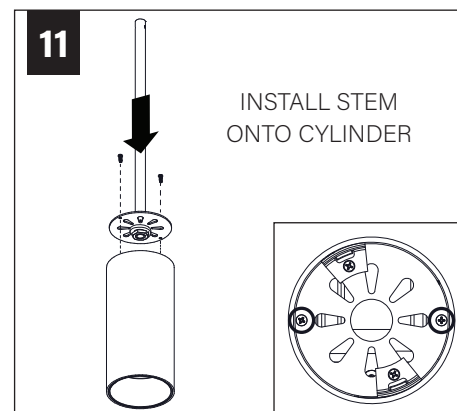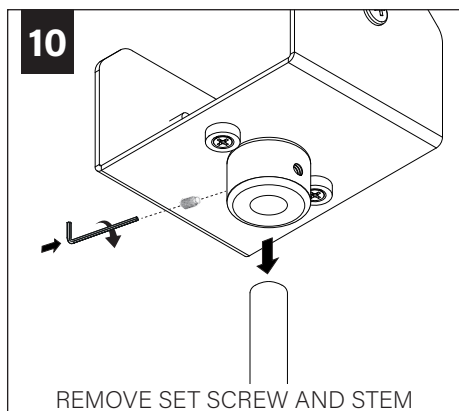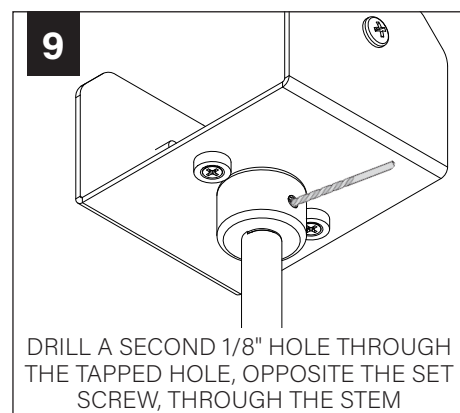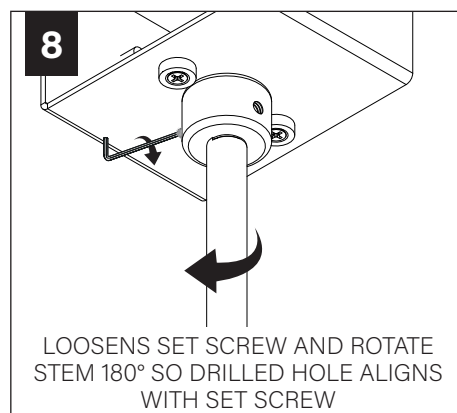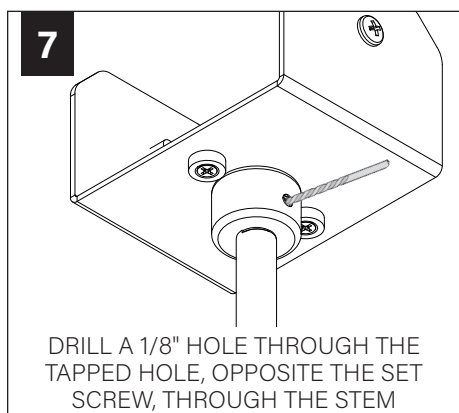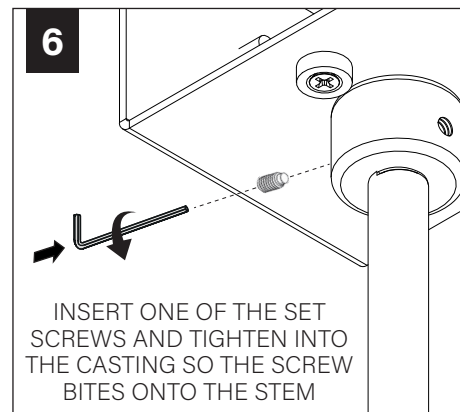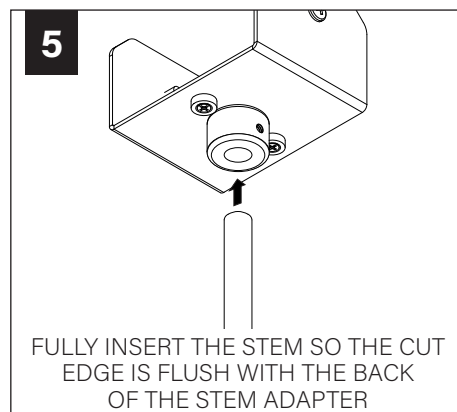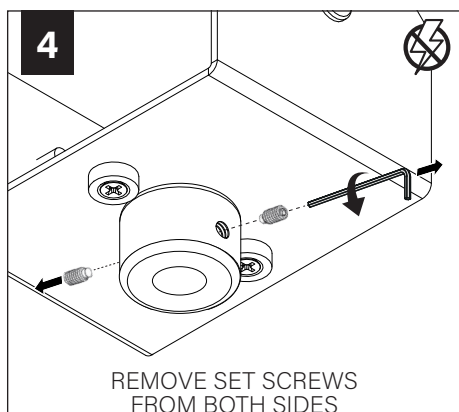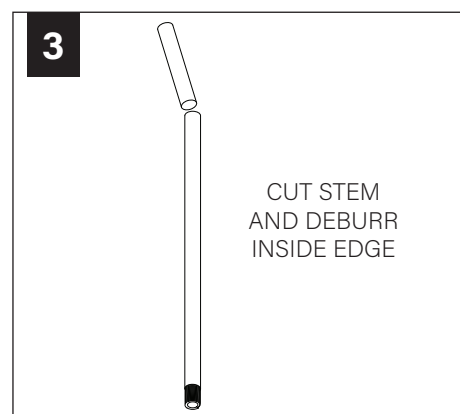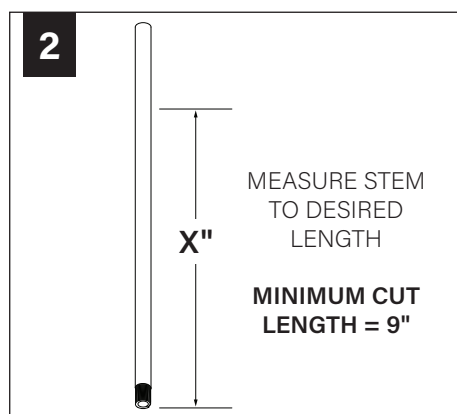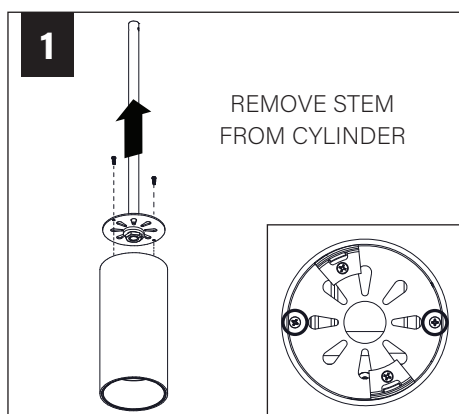

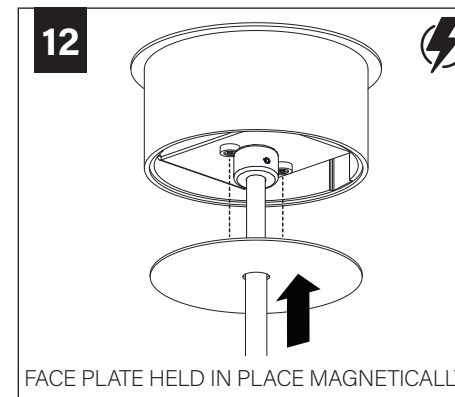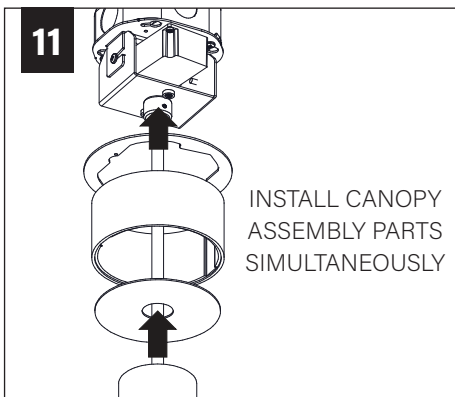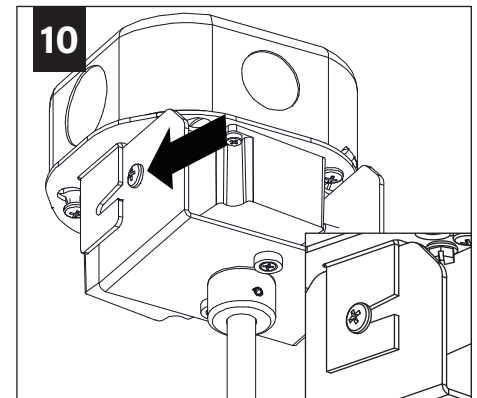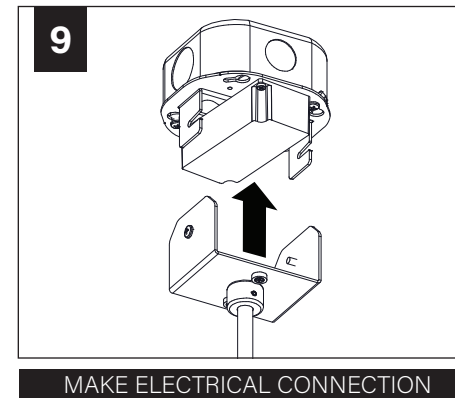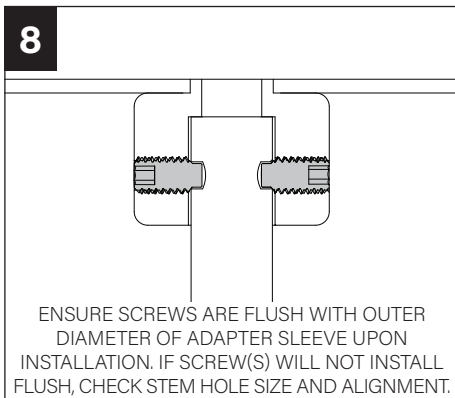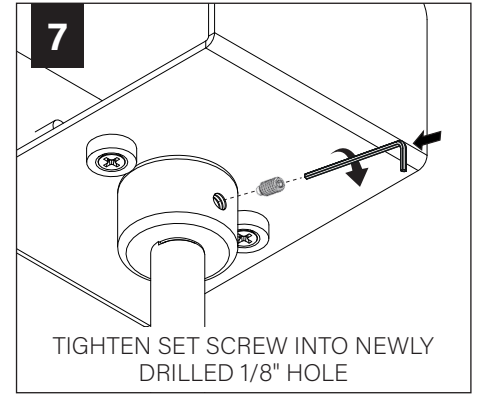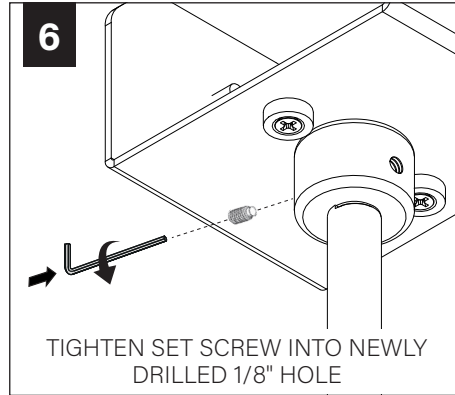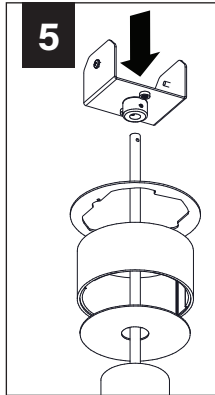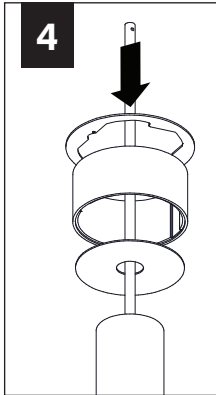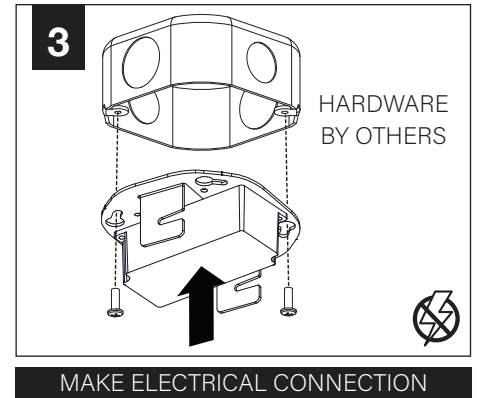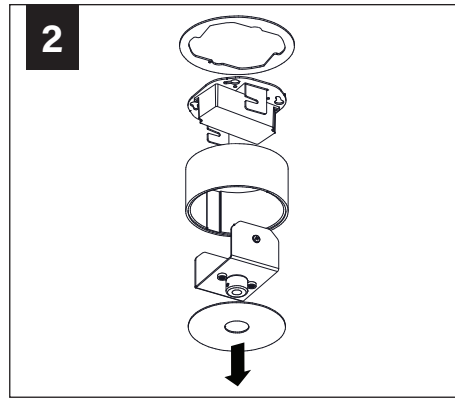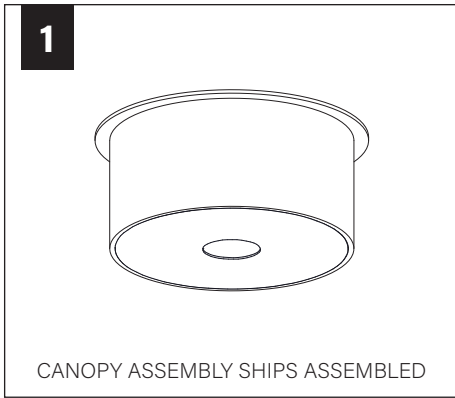


DRIVER SERVICE




**TURN OFF POWER SOURCE
PRIOR TO DRIVER SERVICE**

1

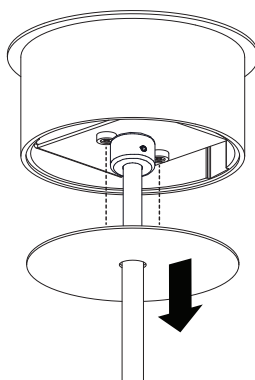


2

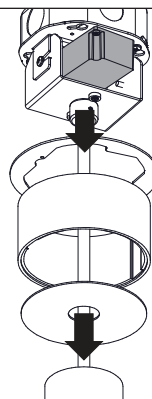


WALL WASH AIMING

1

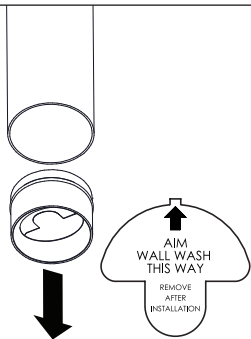


REFLECTOR IS HELD IN
PLACE BY FRICTION

2

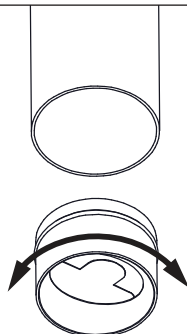


ROTATE REFLECTOR TO
DESIRED POSITION

3

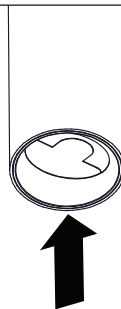

ENSURE REFLECTOR IS FULLY
INSTALLED AND FLUSH WITH THE
BOTTOM OF THE CYLINDER

4

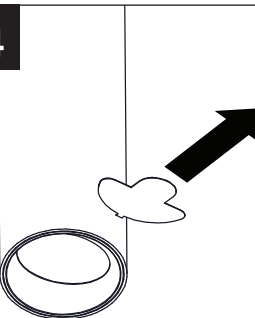


REMOVE AIM ASSIST INSERT

OPTIC SERVICE




DISTRIBUTION KITS INCLUDE AN
OPTIC AND REFLECTOR ASSEMBLY.


**BOTH ITEMS MUST BE USED
TO ACHIEVE SPECIFIED
DISTRIBUTION.**

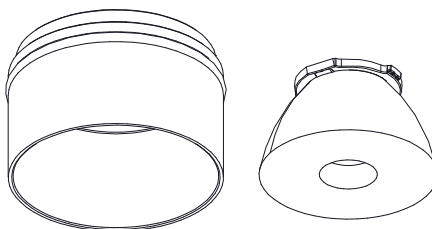


1

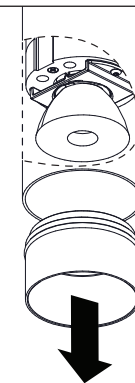


2

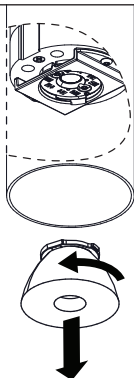

3

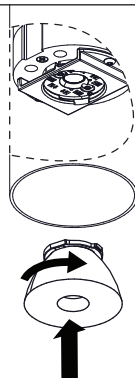

4

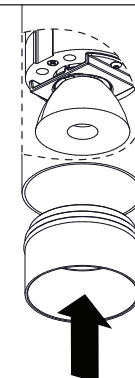

EMERGENCY




SEE BATTERY MANUFACTURER
INSTRUCTIONS

EMERGENCY MAXIMUM MOUNTING HEIGHT:

CD, WH - EM MAX HEIGHT: 16.73'
BK, -WD - EM MAX HEIGHT: 14.96'


1

HARDWARE
BY OTHERS

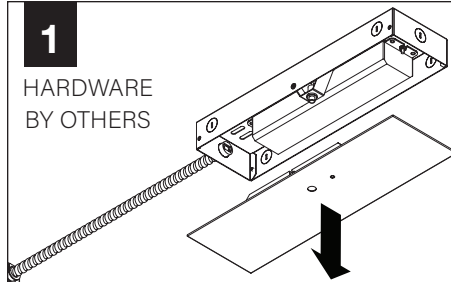


SECURE TO STRUCTURE ABOVE

2

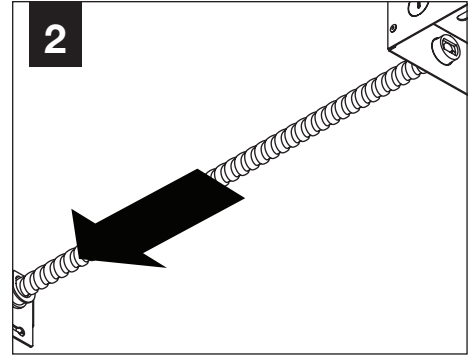


MAKE ELECTRICAL CONNECTION

3

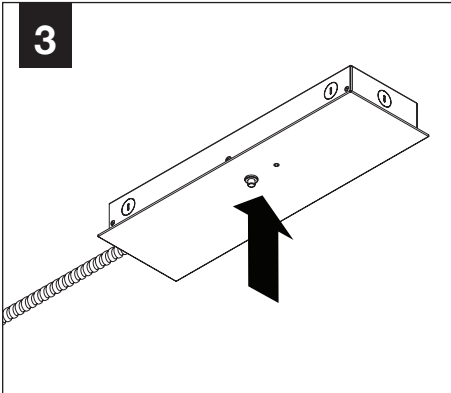

4

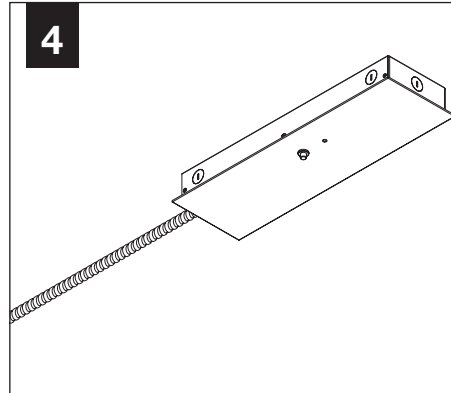

PROCEED TO
LUMINAIRE INSTALLATION