

# Obscura® linear grid


FOSS - G

CONNECTED™  
SOLUTIONS




**! DO NOT POWER LUMINAIRE UNTIL INSTALLATION IS COMPLETE.**  
**SUSPENSION CABLES ARE POWERED. DO NOT ALLOW CABLES TO COME IN CONTACT WITH CONDUCTIVE MATERIALS. !**


FOCAL POINT

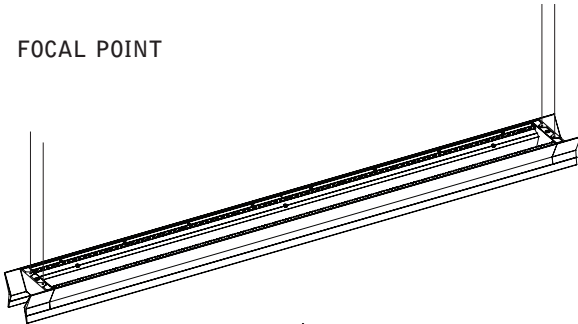

CANOPY  
L x W  
4.00" x 2.00"

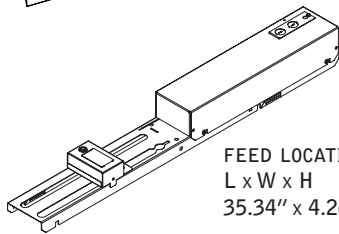

FEED LOCATION  
L x W x H  
35.34" x 4.26" x 3.83"

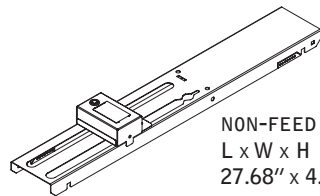

NON-FEED  
L x W x H  
27.68" x 4.22" x 2.79"

EMERGENCY  
L x W x H  
35.34" x 5.57" x 3.83"

KEY



POWER OFF



POWER ON




ATTENTION



SEE ADDITIONAL INSTRUCTIONS


## PARTS LISTS



CABLE SLEEVE  
(700122)



O-RINGS (2 PER CANOPY)  
(700153)



CLEAR CABLE SLEEVE  
(OPTIONAL)  
(700124)

## FEED LOCATIONS



NON-FEED



FEED LOCATION



FEED LOCATION



FEED LOCATION

4' - 8' UNITS


9' - 12' UNIT



DO NOT TRIM EXCESS  
SUSPENSION CABLE UNTIL  
LUMINAIRE IS FULLY ADJUSTED.


CABLES ARE NOT FIELD REPLACABLE.

1













CUTOUT












2

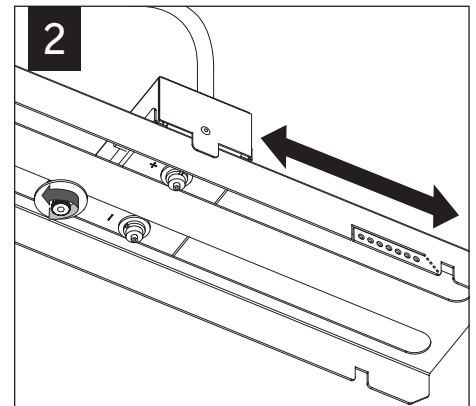

Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).  
To prevent electrical shock, disconnect electrical supply before installation or servicing.

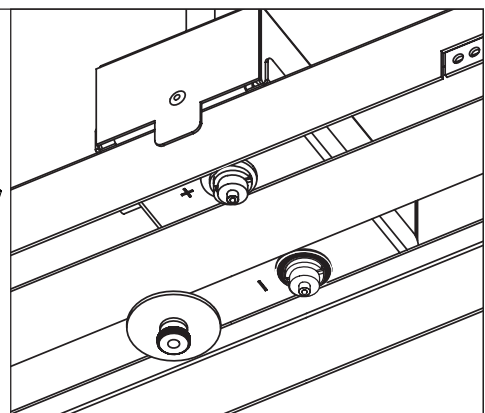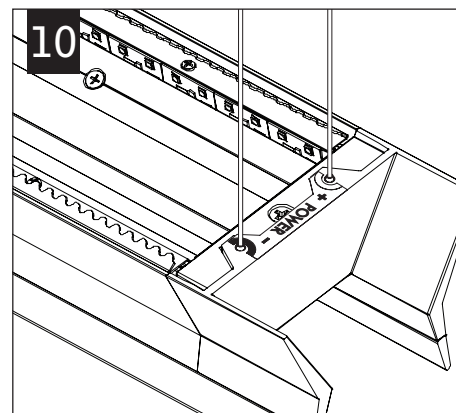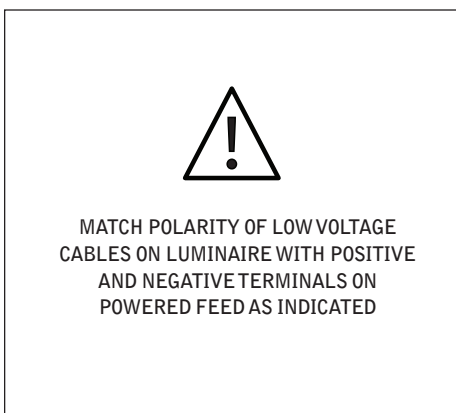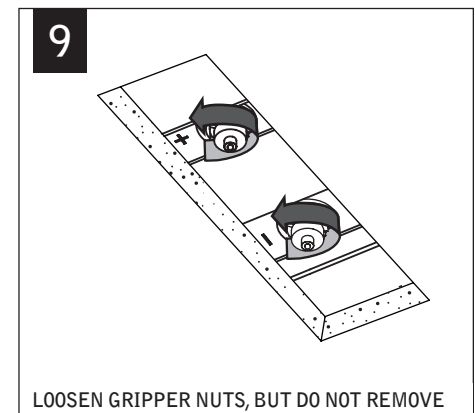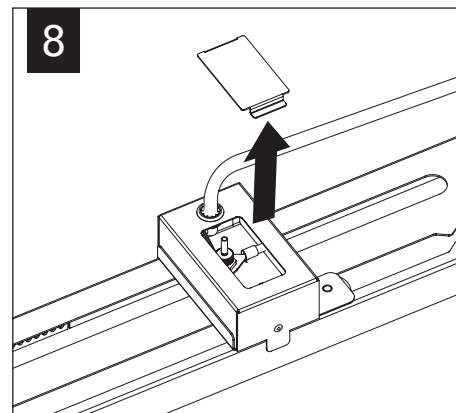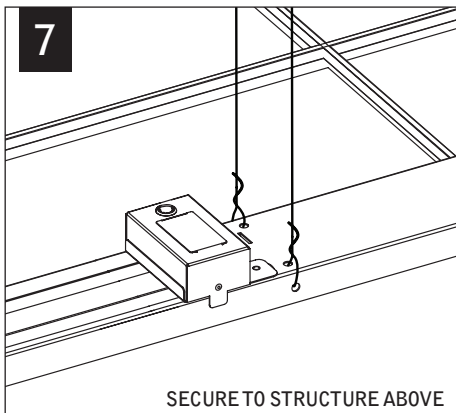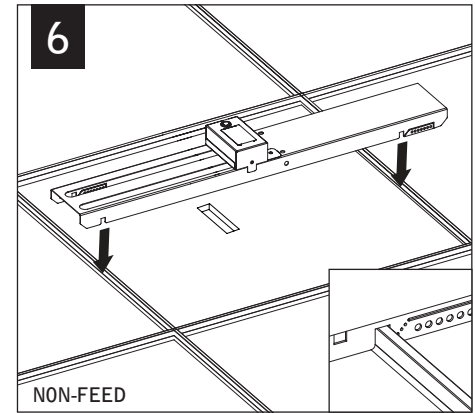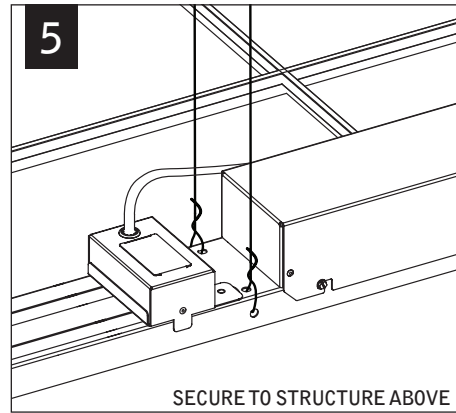
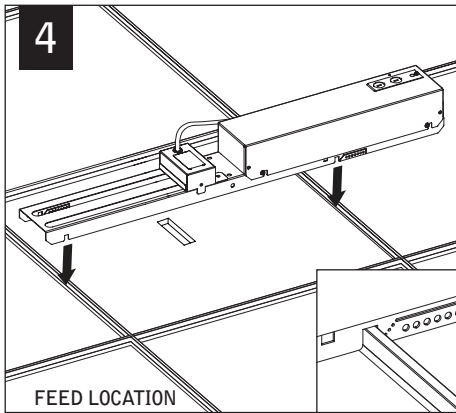
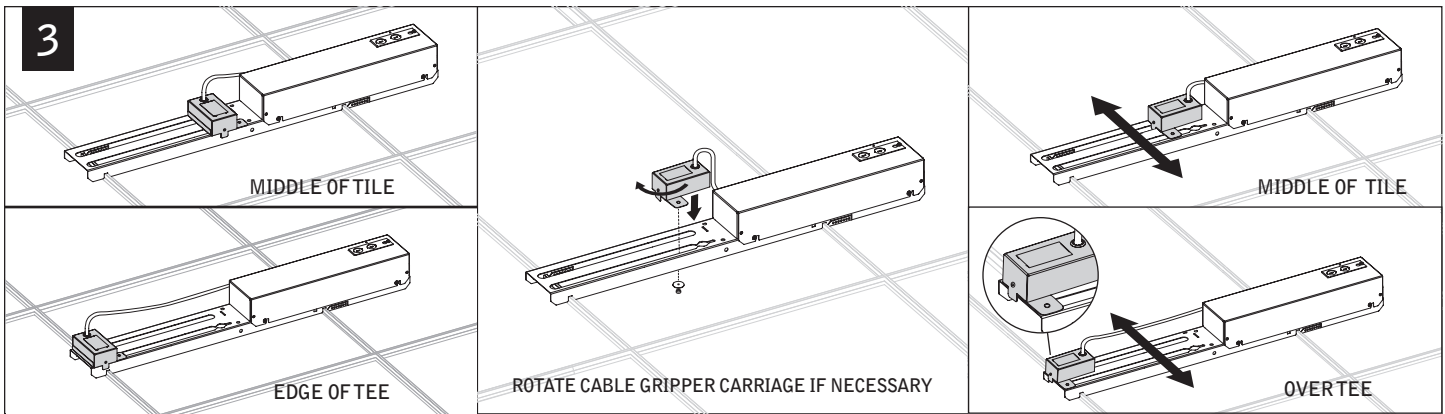


Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).  
To prevent electrical shock, disconnect electrical supply before installation or servicing.

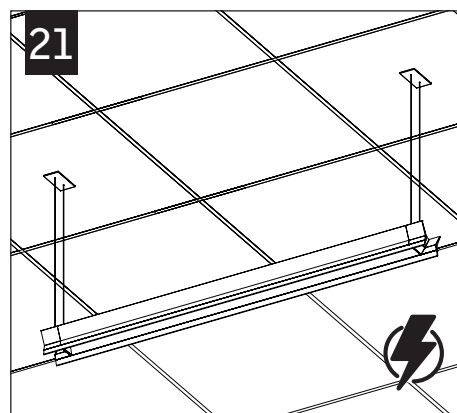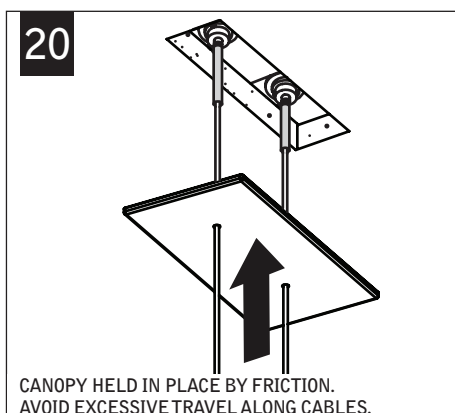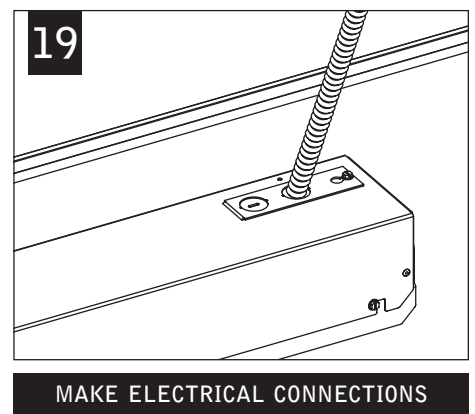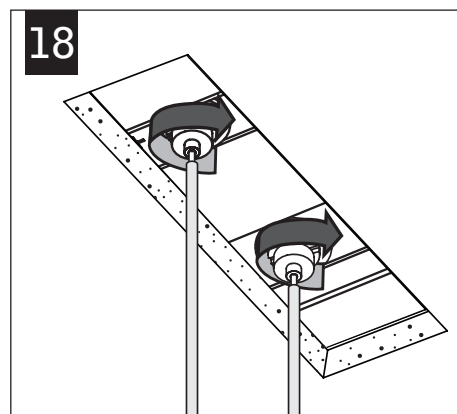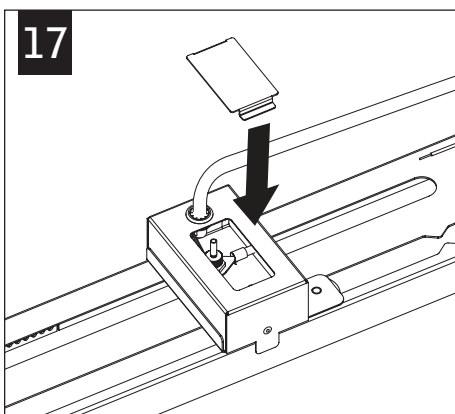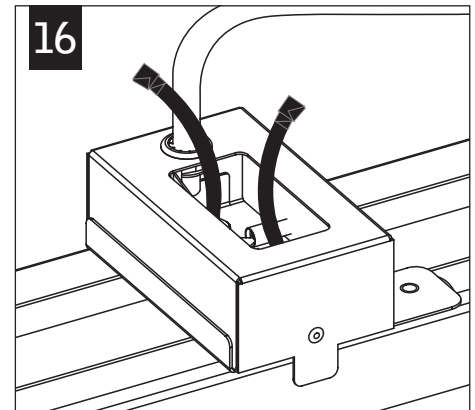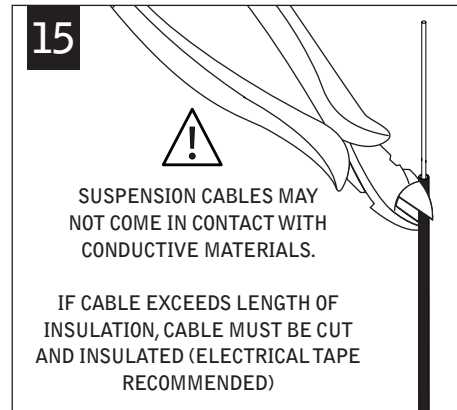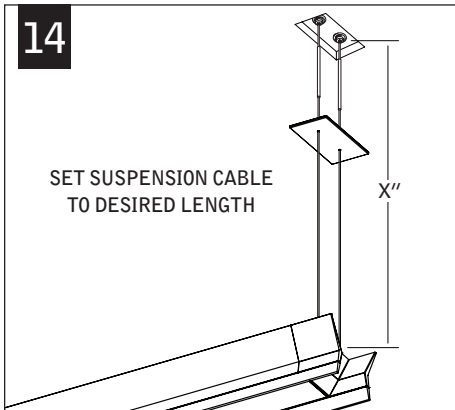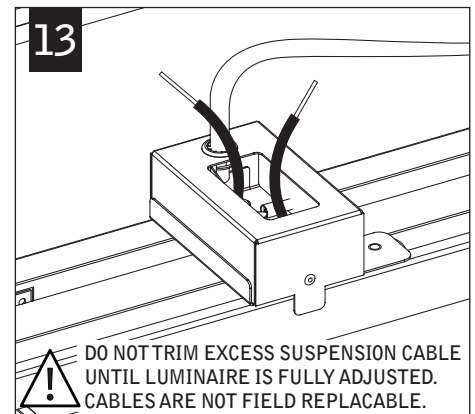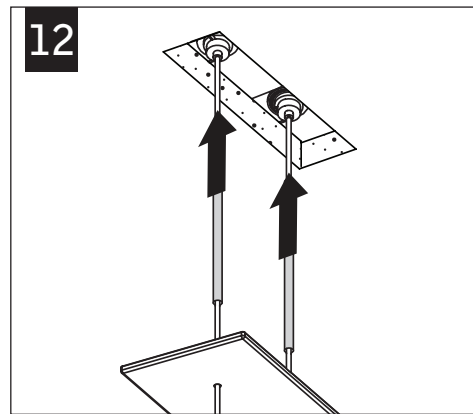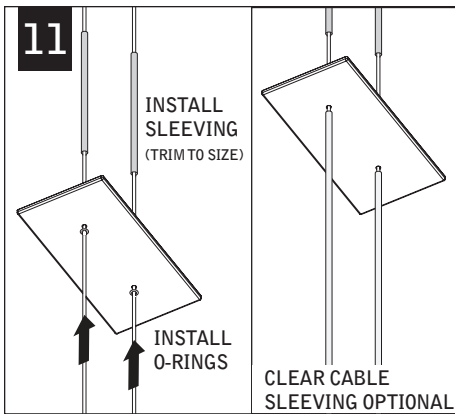


Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).  
To prevent electrical shock, disconnect electrical supply before installation or servicing.

## EMERGENCY

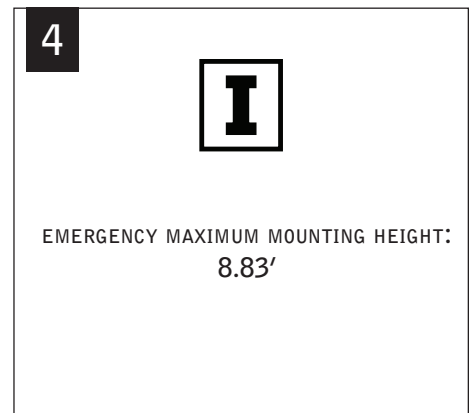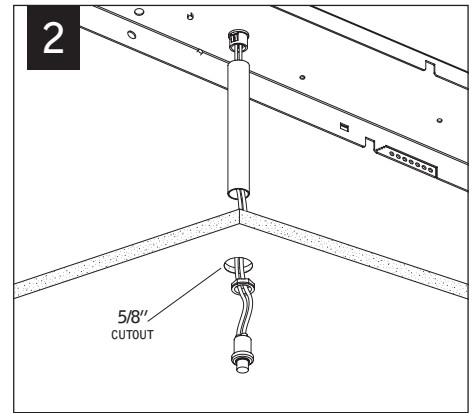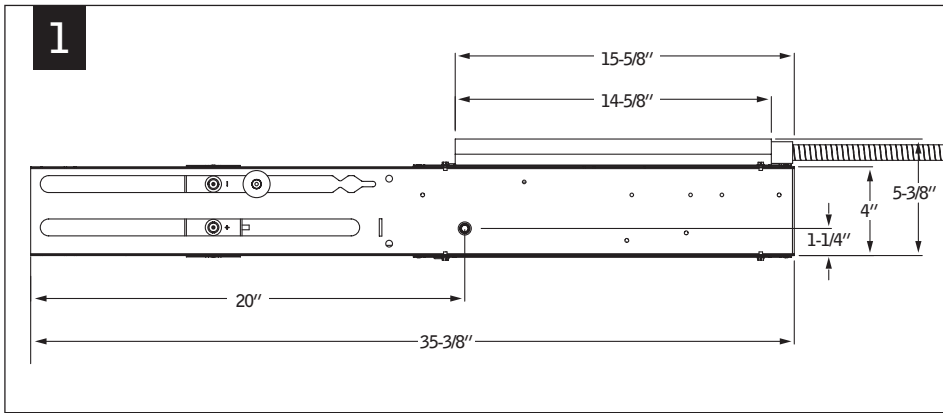



## DRIVER SERVICE

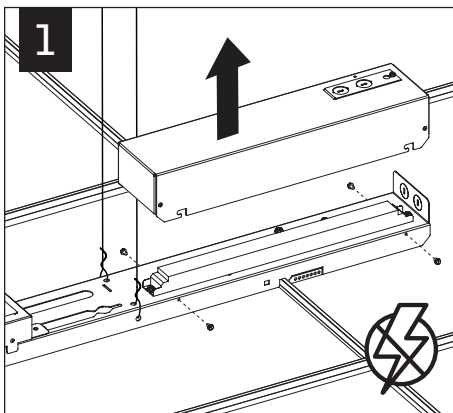

**CONNECTED**  
SOLUTIONS

ACUITY nLIGHT

WATTSTOPPER

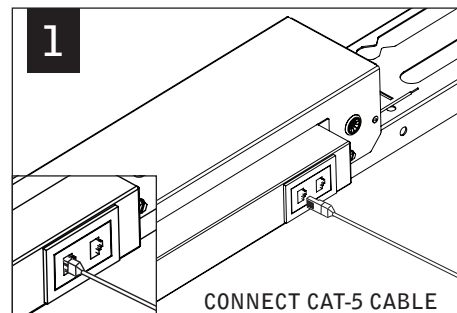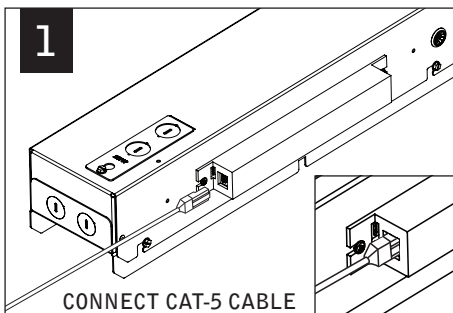

Contractor is responsible for adequately reinforcing walls and/or ceilings to support luminaire weight. Focal Point, LLC accepts no responsibility for inadequately reinforced walls and/or ceilings. The information contained in this drawing is the sole property of Focal Point, LLC. Any reproduction in part or whole without the written permission of Focal Point, LLC is prohibited.