


Skydome® led1x1


FSDL11



FOCAL POINT



OPTIONAL - SOLD SEPARATELY

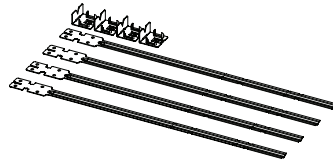

KEY



POWER OFF



POWER ON




ATTENTION




**LUMINAIRE MUST BE INSTALLED PRIOR TO DRYWALL CEILING
NOT RECOMMENDED FOR ON GRID INSTALLATION**


1

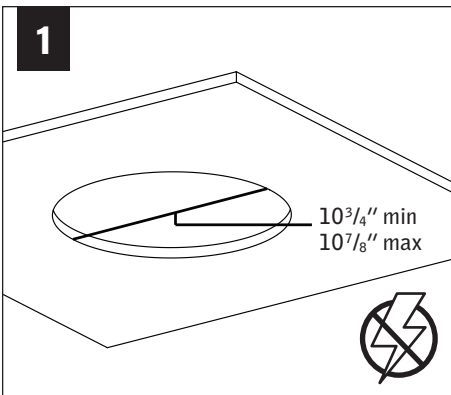

2

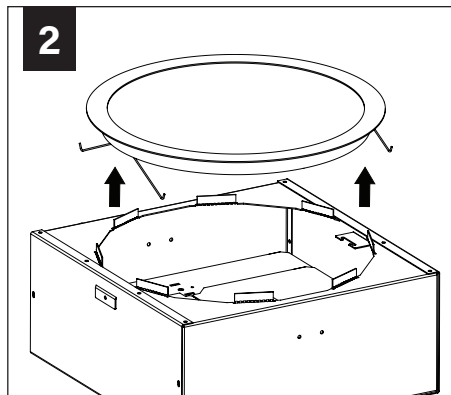


3 x2

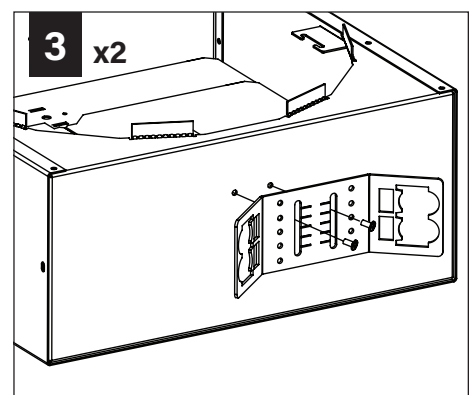


GRID - 1/2" CONDUIT & CLIP (BY OTHERS)


4 x2

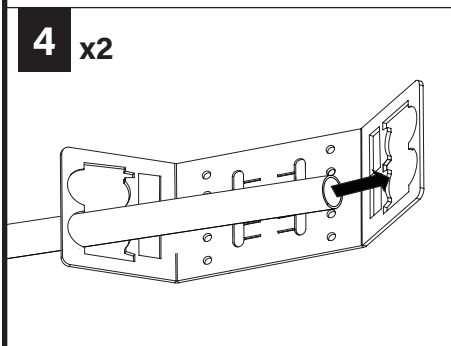

5 x4

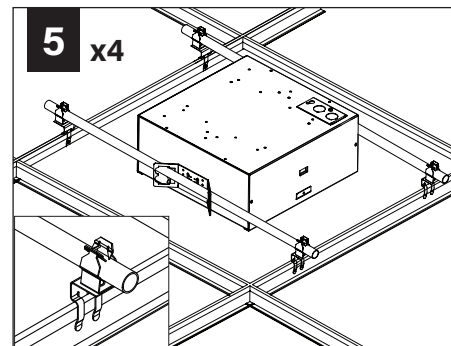


5 STRUCTURE ABOVE

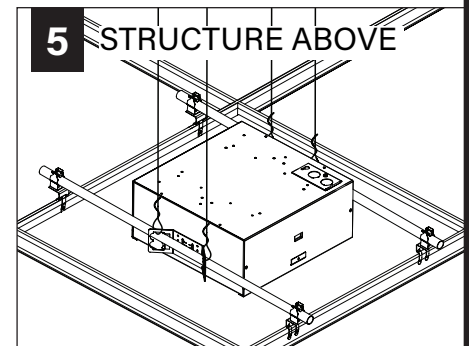


GRID - BAR HANGERS (SOLD SEPARATELY)


4 x2

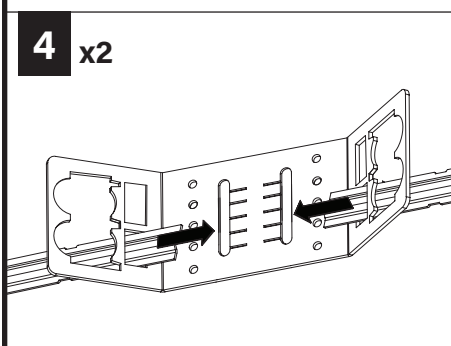

5 x4

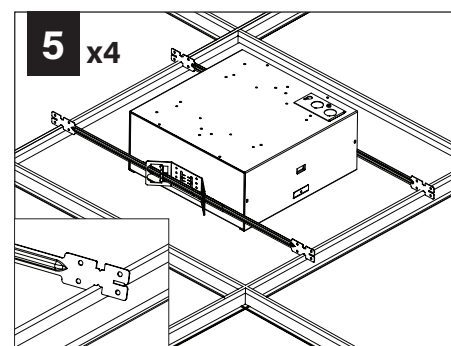


5 STRUCTURE ABOVE

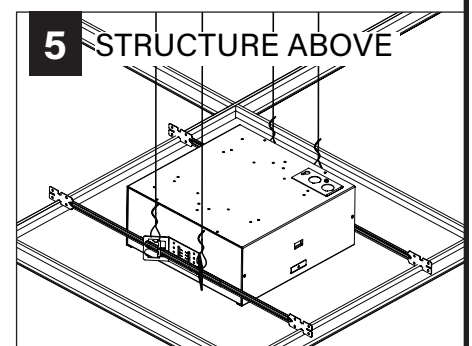

Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
To prevent electrical shock, disconnect electrical supply before installation or servicing.


DRYWALL - BAR HANGERS (SOLD SEPARATELY)

4 x2

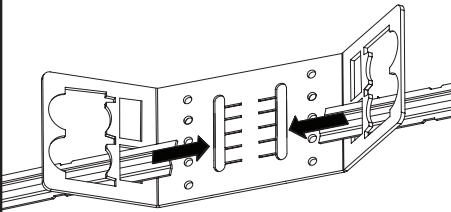


METAL STUDS

5 x4

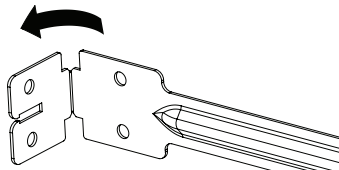


6 x4

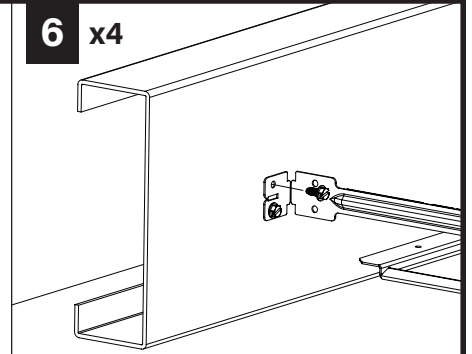


WOOD STUDS


5 x4

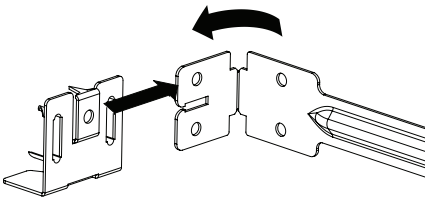


6 x4

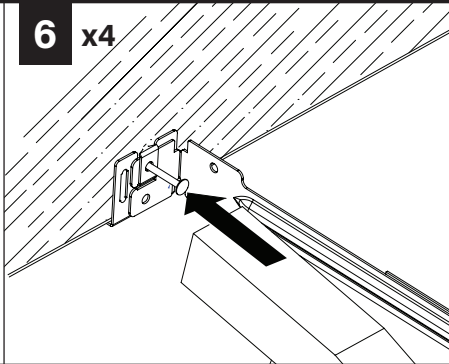

7

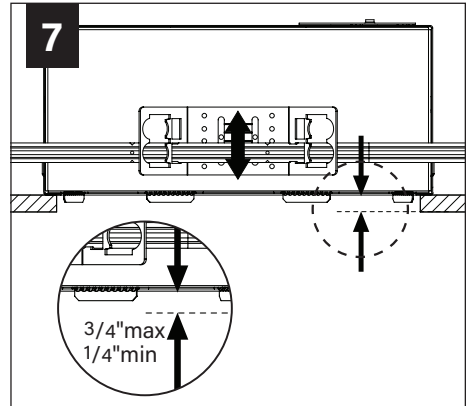


8

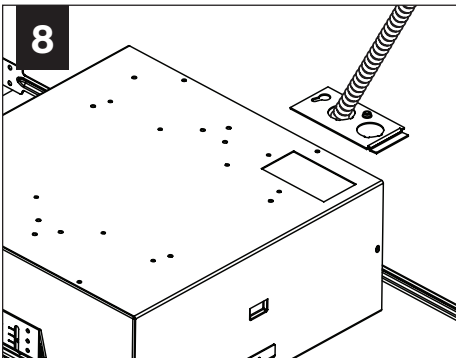

MAKE ELECTRICAL CONNECTIONS

9

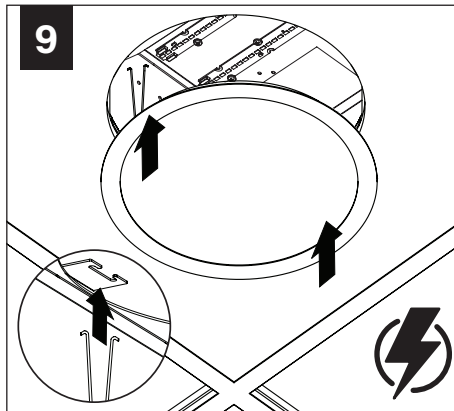

EMERGENCY




SEE BATTERY MANUFACTURER INSTRUCTIONS


**EMERGENCY MAXIMUM MOUNTING HEIGHT:
8.00'**

DRIVER SERVICE


1

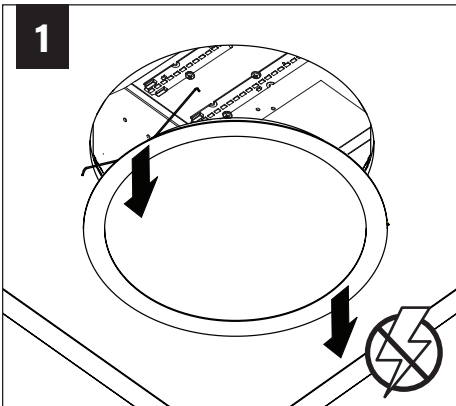

2

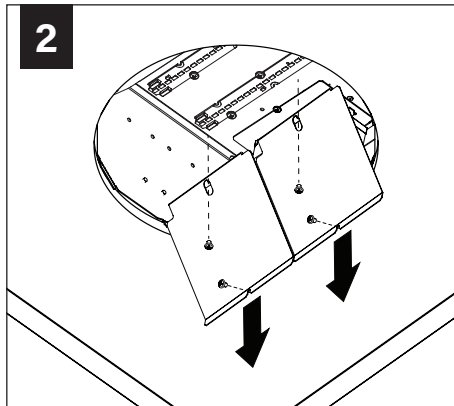

3

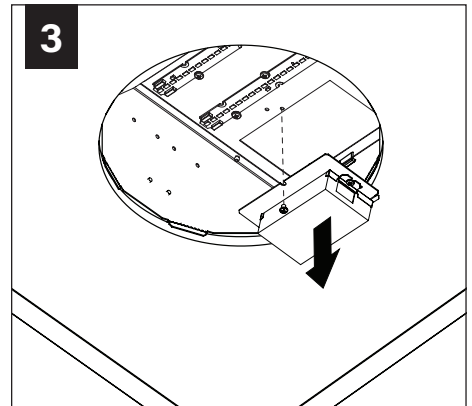

Contractor is responsible for adequately reinforcing walls and/or ceilings to support luminaire weight. Focal Point, LLC accepts no responsibility for inadequately reinforced walls and/or ceilings. The information contained in this drawing is the sole property of Focal Point, LLC. Any reproduction in part or whole without the written permission of Focal Point, LLC is prohibited.