

Skydome® LED

Suspended | FSDL-22|33|44-CS



BEFORE YOU BEGIN

- Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
- To prevent electrical shock, disconnect electrical supply before installation or servicing.
- Contractor is responsible for adequately reinforcing walls and/or ceilings to support fixture weight.
- Focal Point, LLC accepts no responsibility for inadequately reinforced walls and/or ceilings.
- The information contained in this drawing is the sole property of Focal Point, LLC. Any reproduction in part or whole without the written permission of Focal Point, LLC is prohibited.

INSTRUCTION KEY



ATTENTION



SEE ADDITIONAL INSTRUCTIONS



POWER OFF




POWER ON


COMPONENT KEY

FOCAL POINT

Cable Mount

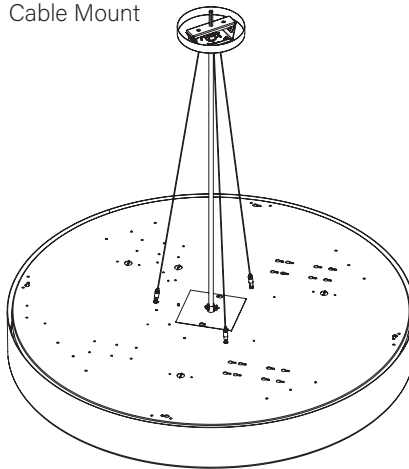

Stem Mount

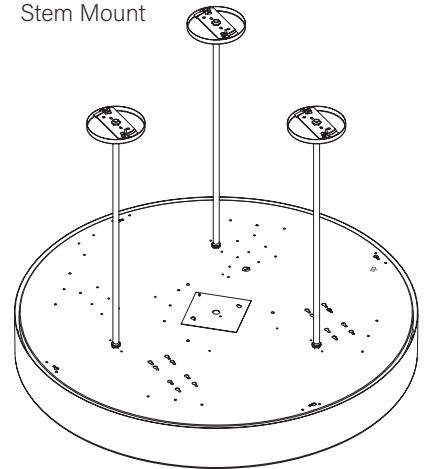


WEIGHTS:

2' - 23 LBS - 2 PEOPLE RECOMMENDED FOR INSTALLATION






3' - 50 LBS - 3 PEOPLE RECOMMENDED FOR INSTALLATION

4' - 72 LBS - 3 PEOPLE RECOMMENDED FOR INSTALLATION

CABLE MOUNT

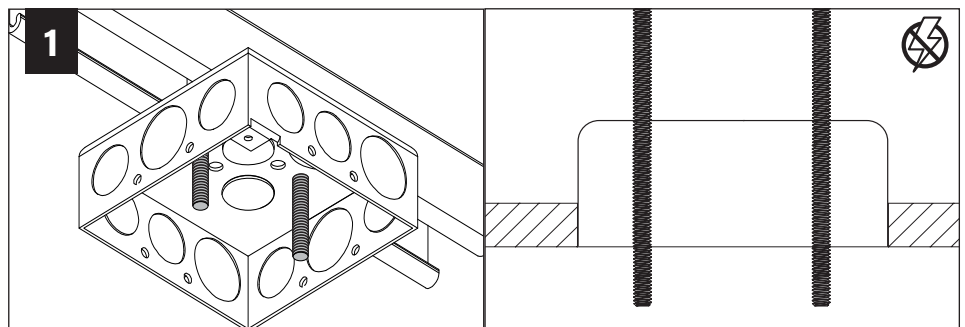


INSTALL J-BOX (BY OTHERS) AND RODS (BY OTHERS)
SECURE RODS TO STRUCTURE ABOVE

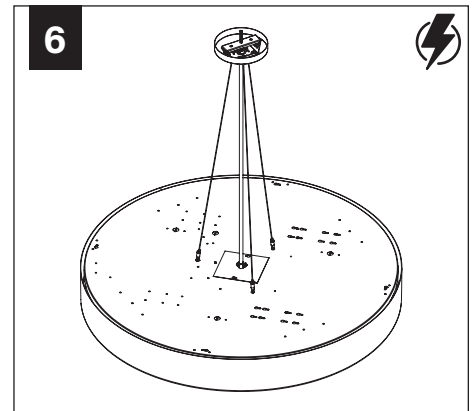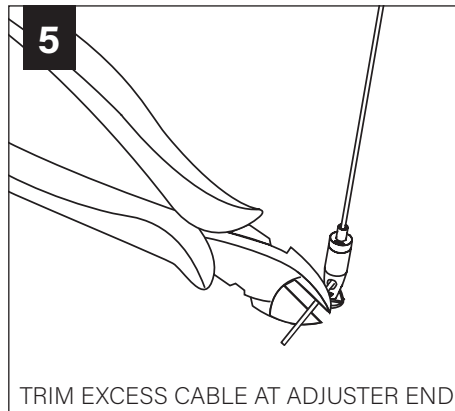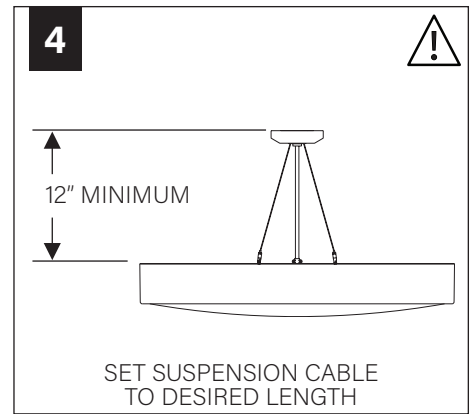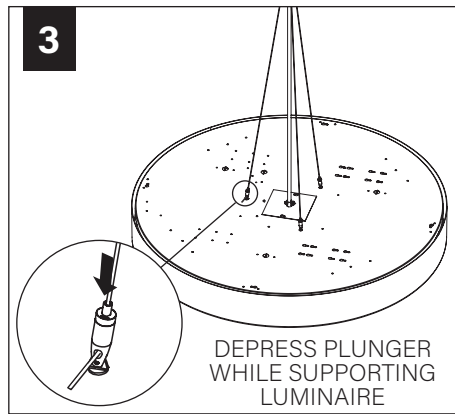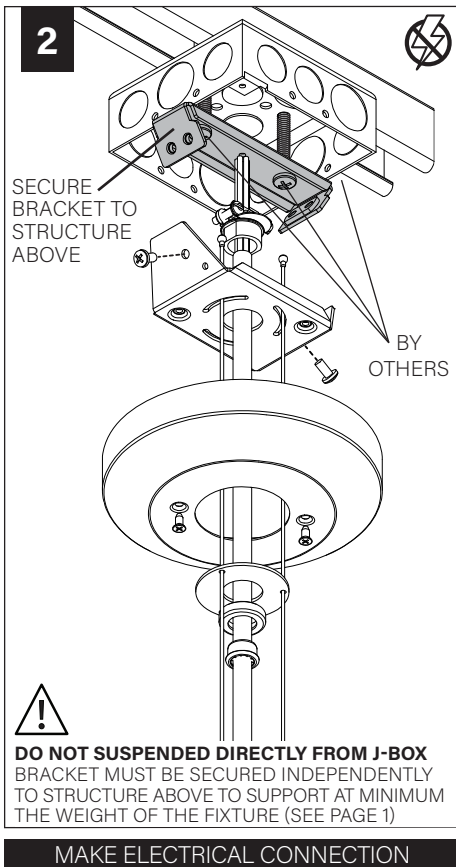


STEM MOUNT


2' DIAMETER

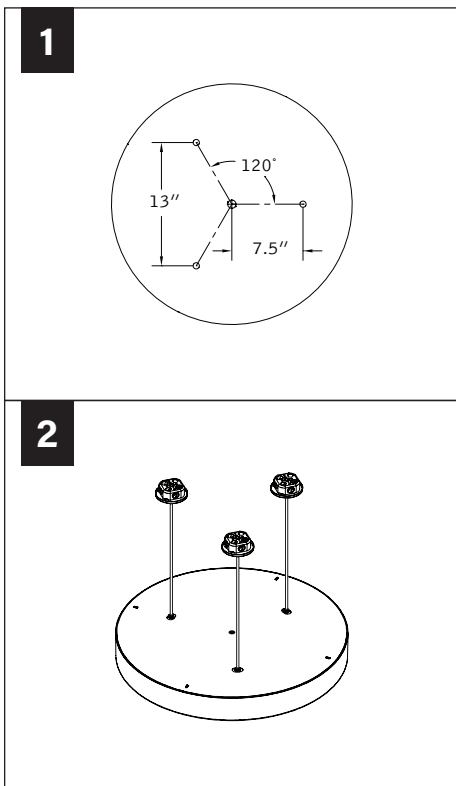


3' DIAMETER

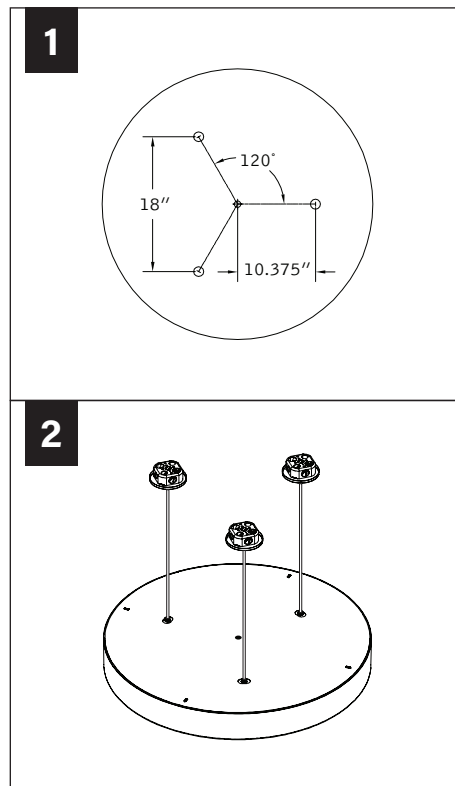


4' DIAMETER

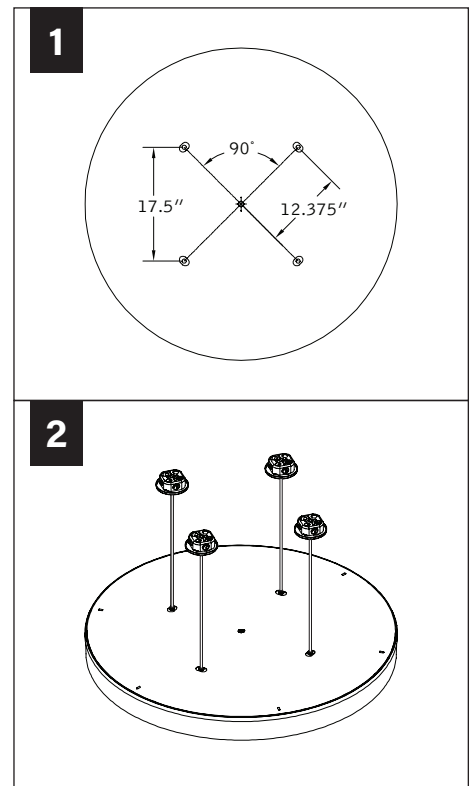

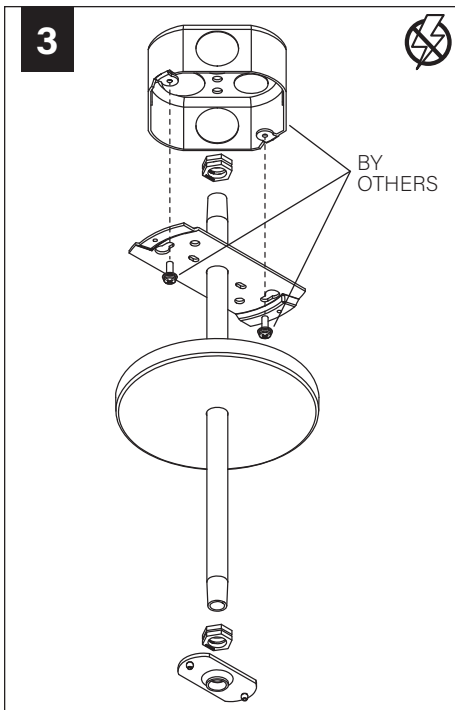


MAKE ELECTRICAL CONNECTION

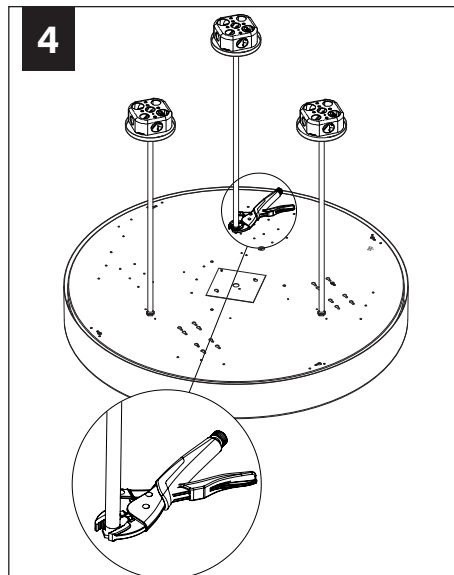


1. ATTACH THE STEM TO COVER. DO NOT OVER TIGHTEN STEM, THIS MAY CAUSE PINCHED WIRES.



2. USING PLIERS, SECURELY TIGHTEN LOCK NUT. STEM MUST BE SECURELY TIGHTENED AND UNABLE TO SPIN LOOSE.

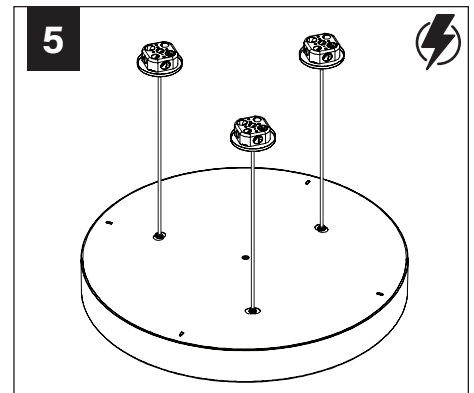

DRIVER SERVICE

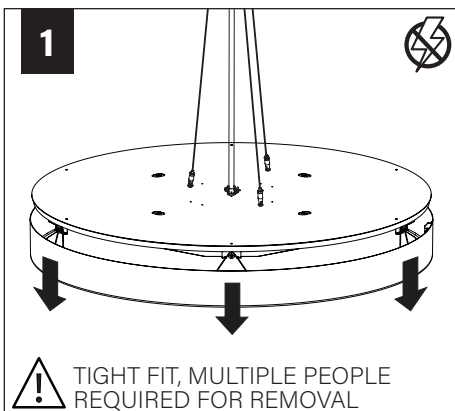

! TIGHT FIT, MULTIPLE PEOPLE REQUIRED FOR REMOVAL

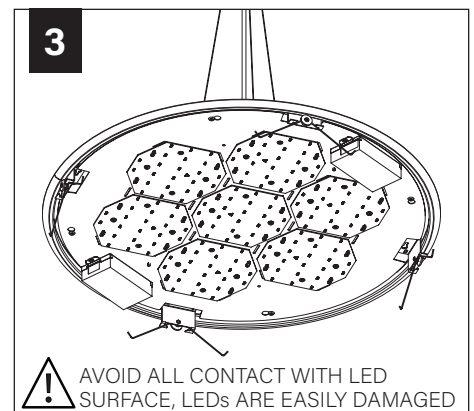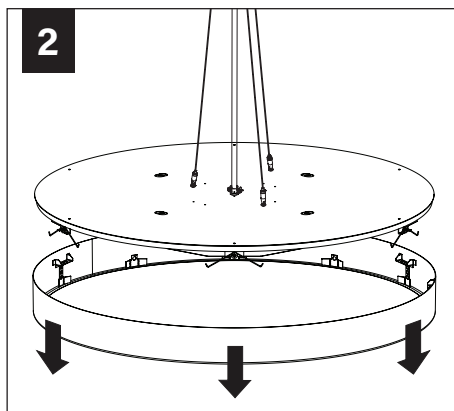

! AVOID ALL CONTACT WITH LED SURFACE, LEDs ARE EASILY DAMAGED

EMERGENCY



SEE BATTERY MANUFACTURER INSTRUCTIONS

EMERGENCY MAXIMUM MOUNTING HEIGHT:
16.00'