

Seem® 4 led suspended



FSM4LS

CONNECTED™
SOLUTIONS



! CONFIGURATIONS ARE RUN SPECIFIC, PLEASE CONSULT FACTORY DRAWINGS BEFORE BEGINNING INSTALLATION. !

FOCAL POINT

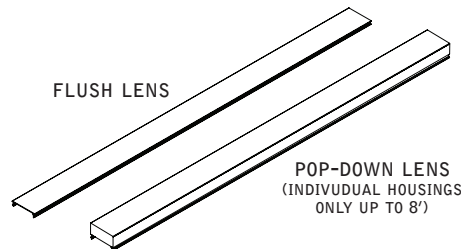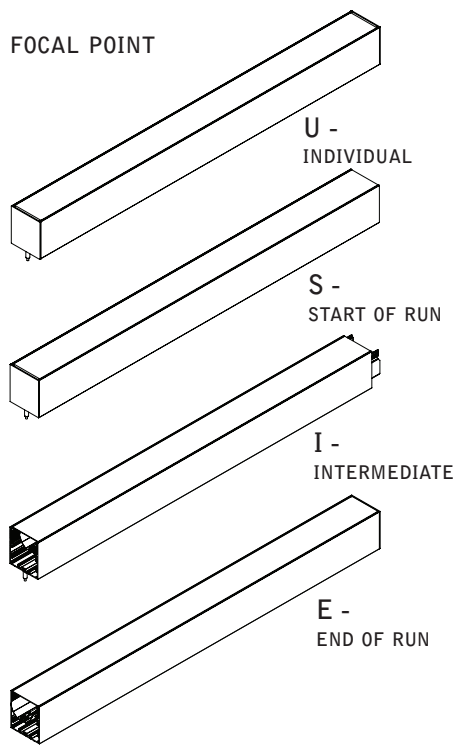

KEY



POWER OFF



ATTENTION



POWER ON



SEE ADDITIONAL INSTRUCTIONS



9-12' LUMINAIRES SHIP ON 13' (157") PALLETS, FORKLIFT EXTENSIONS OF 72" ARE REQUIRED TO AVOID DAMAGE.

INDIVIDUAL INSTALLATIONS FOLLOW STEPS 1, 2, 5, 6, 14 & 15

PARTS LISTS

SHIPPED IN HARDWARE BAG



REFLECTOR (70008)
(6-32 X 5/16 PAN-HEAD
MACHINE SCREW)




CABLE GRIPPER (73014)
& NYLON NUT (70044)

SHIPPED INSTALLED





JOINER PIN
(W5687)









JOINER
BRACKET
(18338)





JOINER BRACKET
(11849)

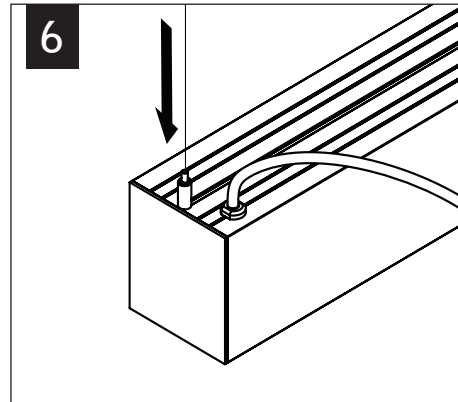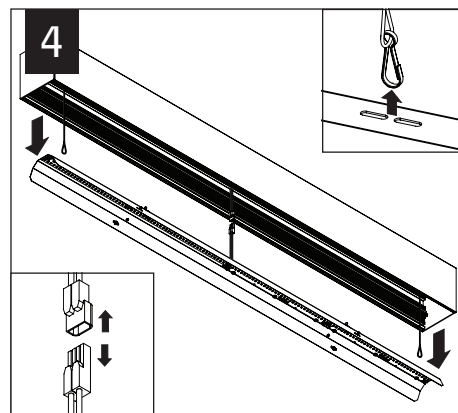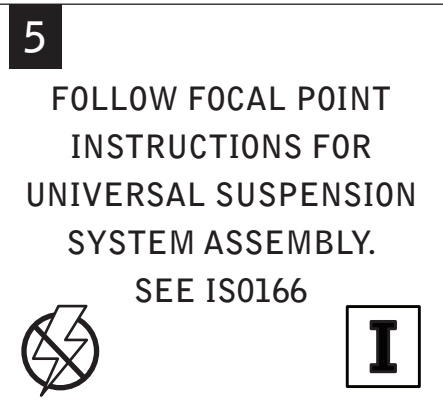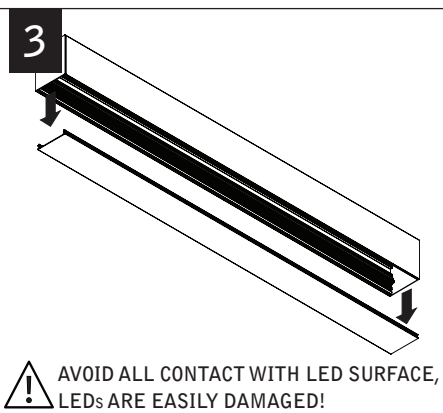

Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
To prevent electrical shock, disconnect electrical supply before installation or servicing.

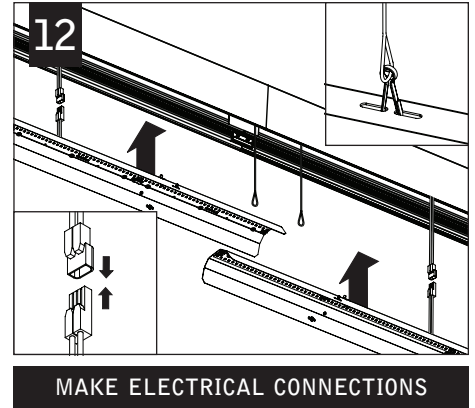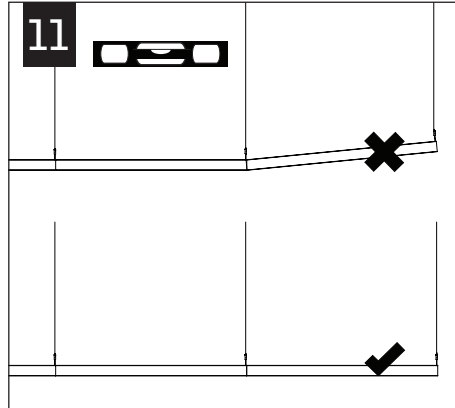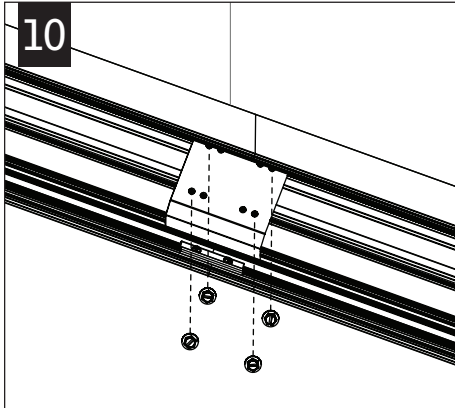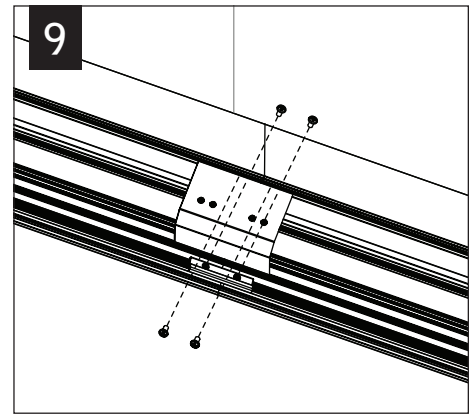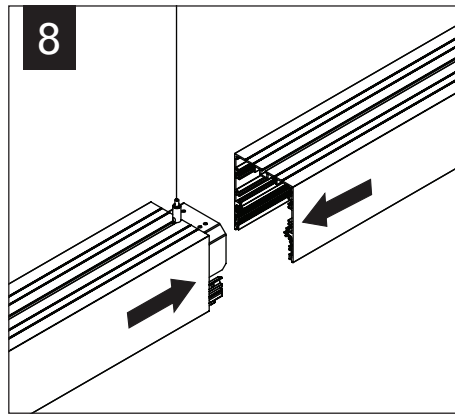
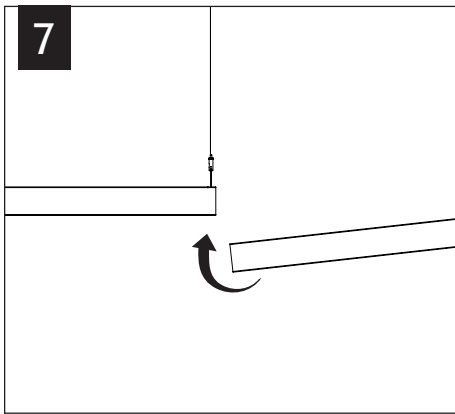


MAKE ELECTRICAL CONNECTIONS

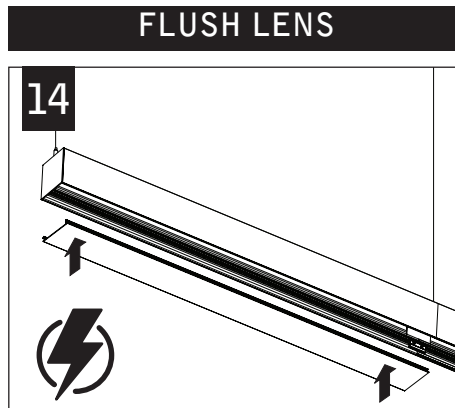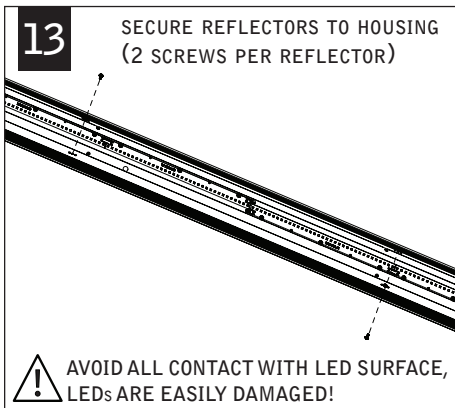




FLUSH LENS

POP-DOWN LENS

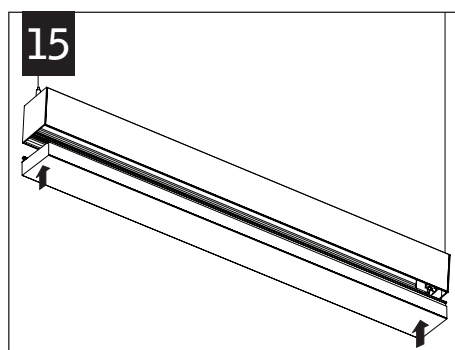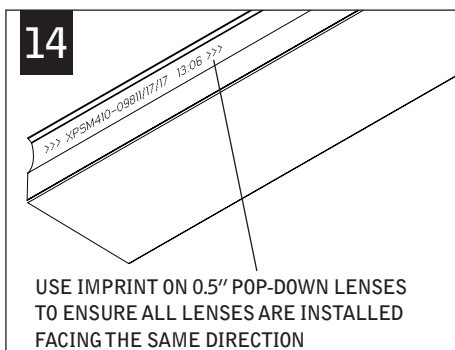

Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
To prevent electrical shock, disconnect electrical supply before installation or servicing.

DRIVER SERVICE

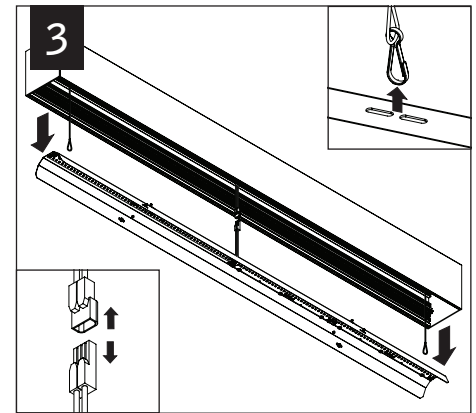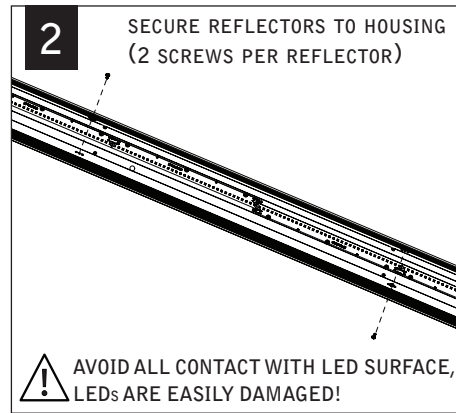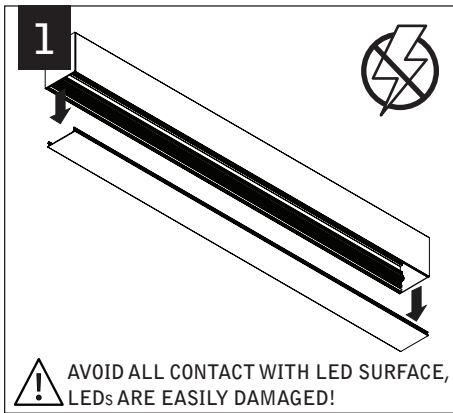

EMERGENCY








SEE BATTERY MANUFACTURER INSTRUCTIONS

EMERGENCY MAXIMUM MOUNTING HEIGHT:
19.00'



ACUITY nLIGHT

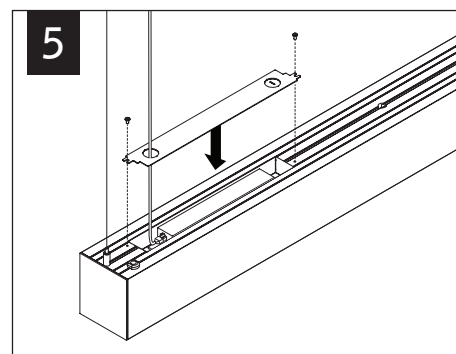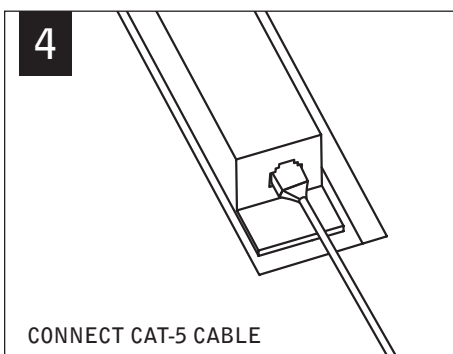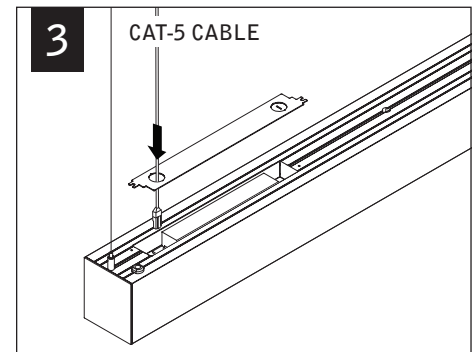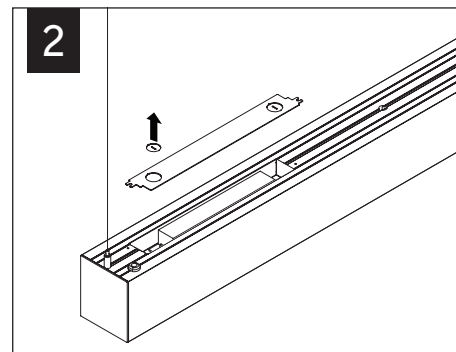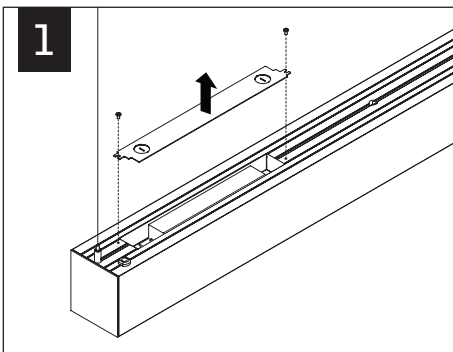

Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
To prevent electrical shock, disconnect electrical supply before installation or servicing.

WATTSTOPPER

