

seem 4™ led regress grid ceiling


FSM4L-SR

CONNECTED™
SOLUTIONS



! CONFIGURATIONS ARE RUN SPECIFIC, PLEASE CONSULT FACTORY DRAWINGS BEFORE BEGINNING INSTALLATION. !

FOCAL POINT

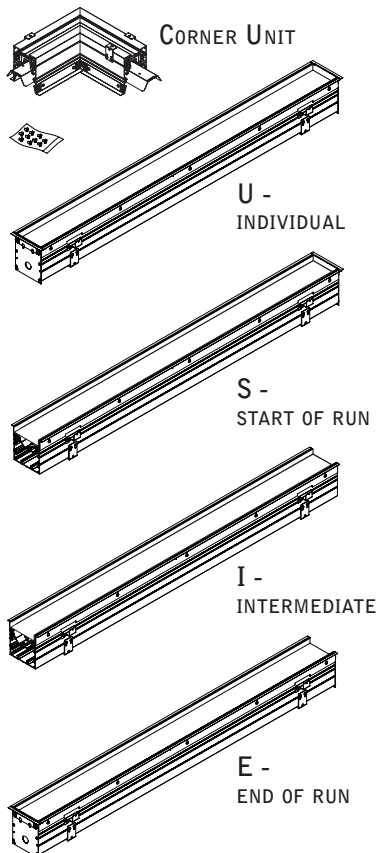


PARTS LISTS

| INCLUDED HARDWARE | | |
|---|--|--|
| | | |
| REFLECTOR SCREW (70008) | | |
| PARTS SHIPPED INSTALLED | | |
| | | |
| TIE-WIRE BRACKET SCREW (72010) (8-18 x 1/4 SELF TAPPING SCREW) | TIE-WIRE BRACKET (12547) | ALIGNMENT PIN (REGRESS LENS) (22372) |
| | | |
| JOINER BRACKET (REGRESS LENS) (A20081-01) | ALIGNMENT BRACKET (REGRESS LENS) (A22092-01) | ALIGNMENT BRACKET SCREW (REGRESS LENS) (72029) |

KEY




! GRID SPACING FOR ALL GRID TYPES

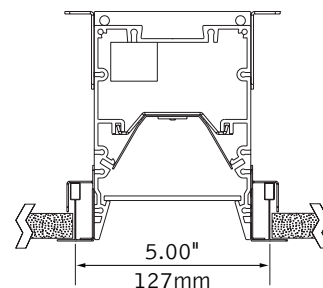


RAIL & CLIP GUIDE




CHECK RAIL & CLIP POSITIONS BEFORE INSTALLATION. ARROWS INDICATE SCREW POSITIONS. TO CHANGE IN THE FIELD REMOVE AND REINSTALL ACCORDING TO DIAGRAMS BELOW.

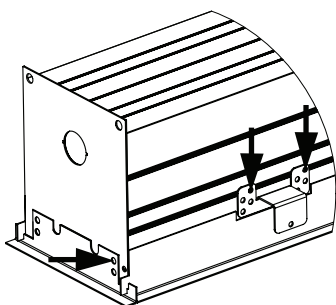


G1: STD 15/16" LAY-IN TILE
G2: STD 9/16" LAY-IN TILE

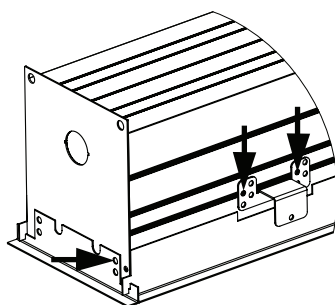

G4: TALL 15/16" LAY-IN TILE
G5: TALL 9/16" LAY-IN TILE

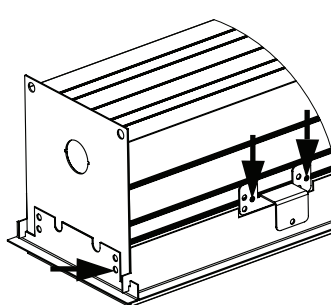

G3: 9/16" SLOT-TEE TEGULAR TILE
T1: STD 15/16" TEGULAR TILE
T2: STD 9/16" TEGULAR TILE
T6: 9/16" NODE TEGULAR TILE

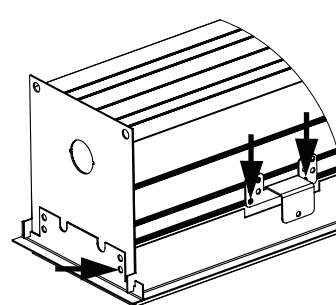


T4: TALL 15/16" TEGULAR TILE
T5: TALL 9/16" TEGULAR TILE












STD = 1-1/2" TEE HEIGHT, TALL = 1-11/16" TEE HEIGHT

Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
To prevent electrical shock, disconnect electrical supply before installation or servicing.


CORNER ASSEMBLY

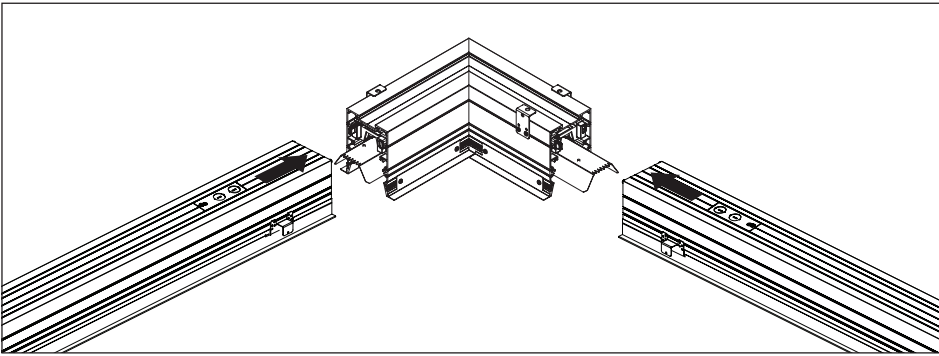

JOINING INSTALLATIONS
SKIP TO STEP 4

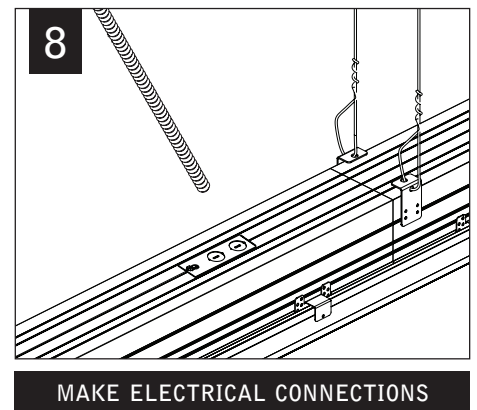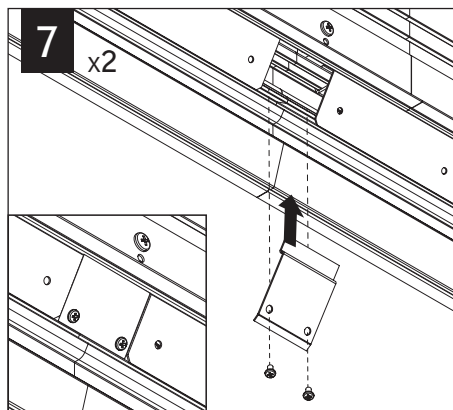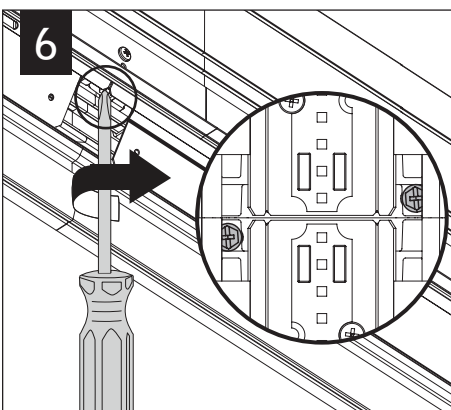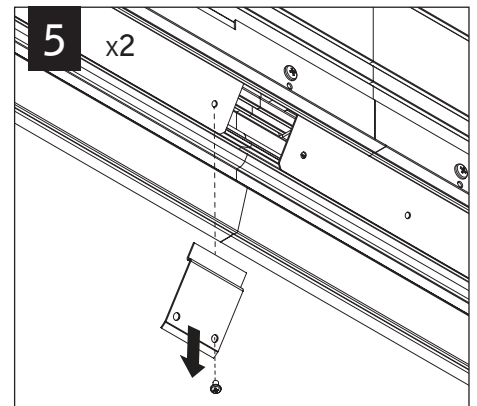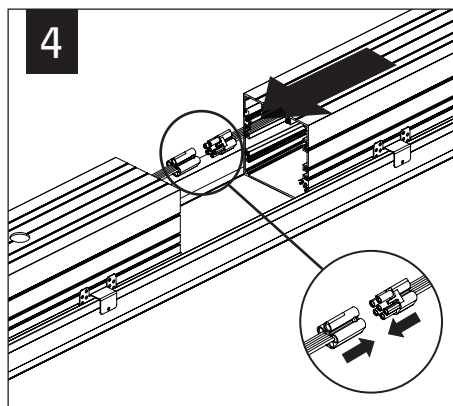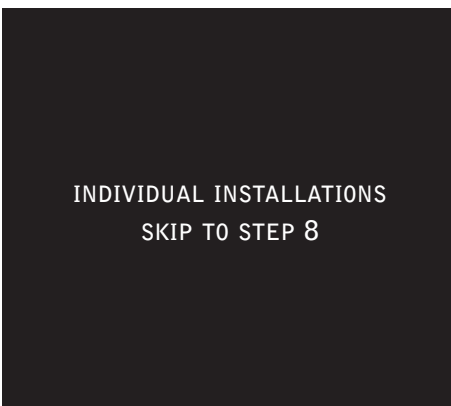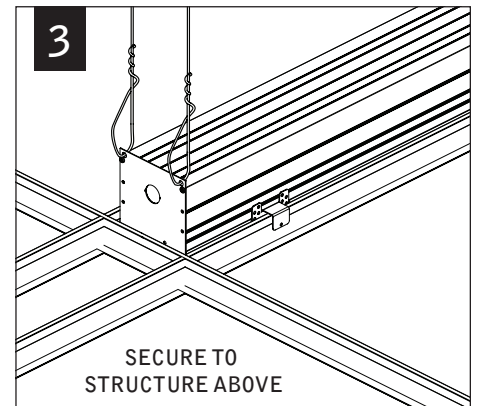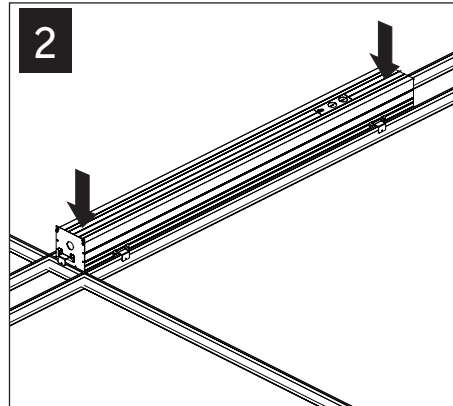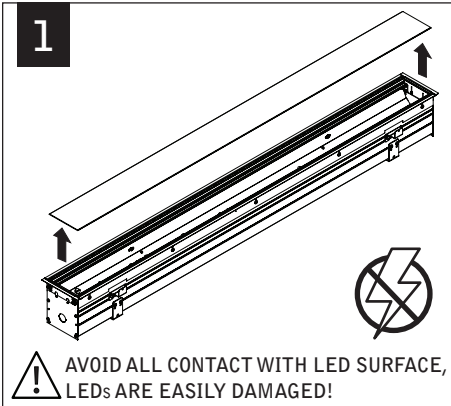

Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
To prevent electrical shock, disconnect electrical supply before installation or servicing.

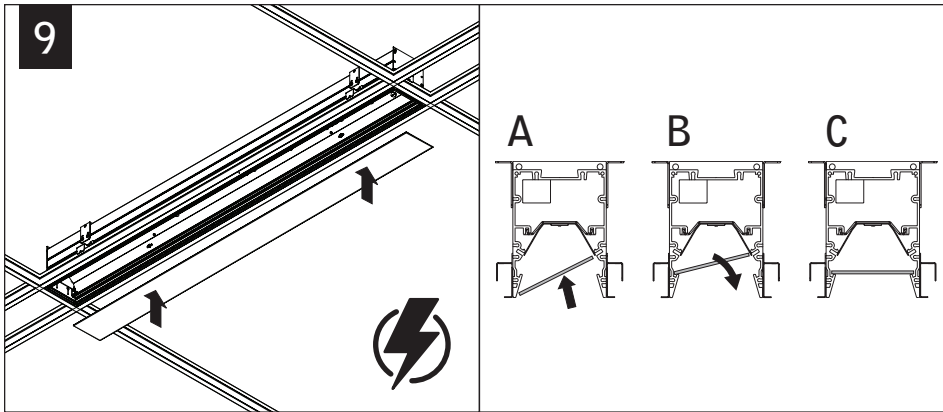




EMERGENCY



SEE BATTERY MANUFACTURER
INSTRUCTIONS






EMERGENCY MAXIMUM MOUNTING HEIGHT:
13.00'

DRIVER SERVICE

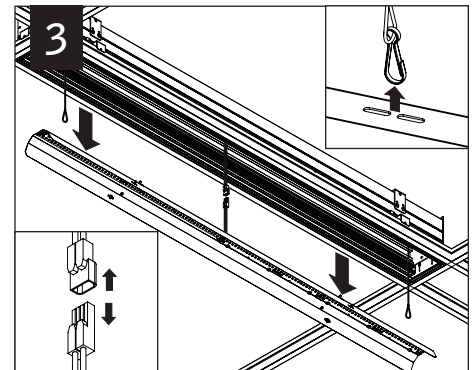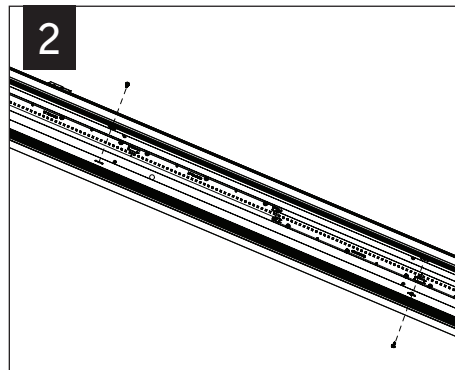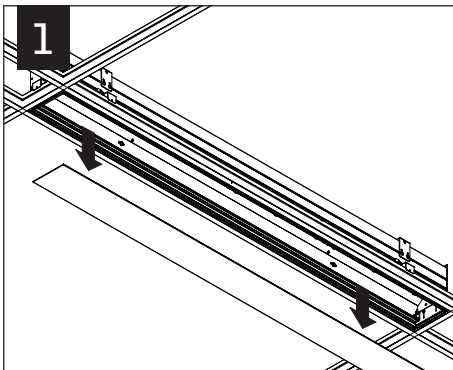

Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
To prevent electrical shock, disconnect electrical supply before installation or servicing.

ACUITY nLIGHT

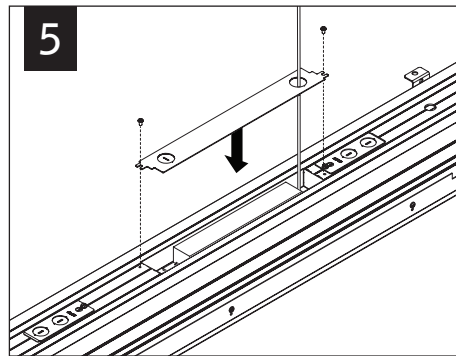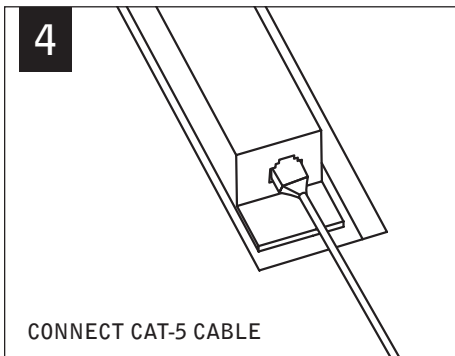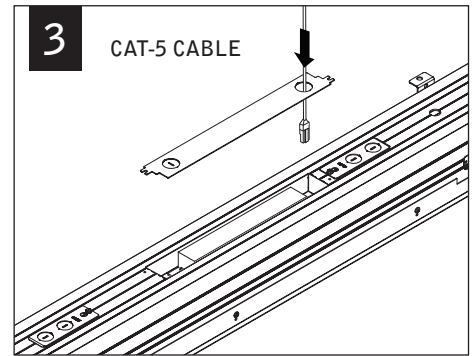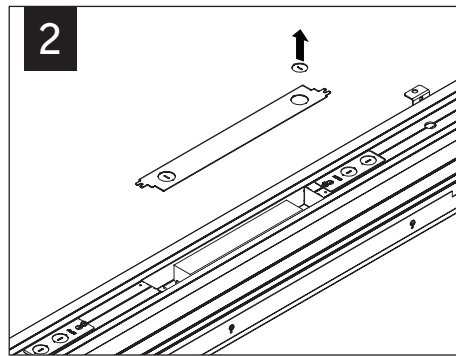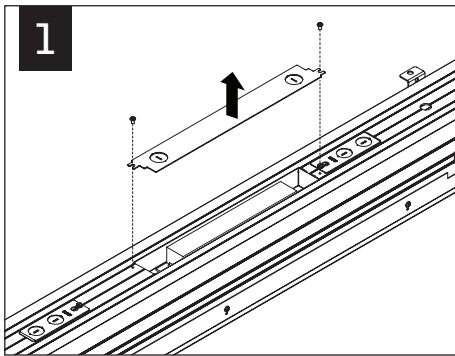

WATTSTOPPER

