


seem 4™ led regress grid ceiling

FSM4L-SR



! CONFIGURATIONS ARE RUN SPECIFIC, PLEASE CONSULT FACTORY DRAWINGS BEFORE BEGINNING INSTALLATION. !

FOCAL POINT

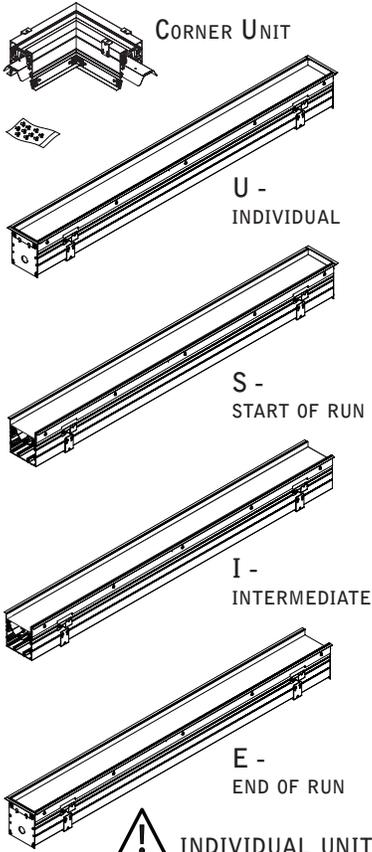

! INDIVIDUAL UNITS CANNOT BE JOINED IN THE FIELD.

PARTS LISTS


INCLUDED HARDWARE
<p>REFLECTOR SCREW (70008)</p>

PARTS SHIPPED INSTALLED		
<p>TIE-WIRE BRACKET SCREW (72010) (8-18 x 1/4 SELF TAPPING SCREW)</p>	<p>TIE-WIRE BRACKET (12547)</p>	
<p>JOINER BRACKET (REGRESS LENS) (A32110-01)</p>	<p>ALIGNMENT BRACKET (REGRESS LENS) (A22092-01)</p>	<p>ALIGNMENT BRACKET SCREW (REGRESS LENS) (72029)</p>
<p>(72074)</p>		
<p>(700158)</p>		
<p>(A32074-01)</p>		

KEY


- POWER OFF
- POWER ON
- ATTENTION

! GRID SPACING FOR ALL GRID TYPES

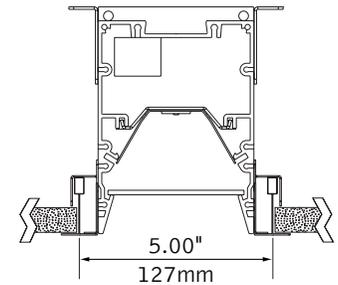


RAIL & CLIP GUIDE


! CHECK RAIL & CLIP POSITIONS BEFORE INSTALLATION. ARROWS INDICATE SCREW POSITIONS. TO CHANGE IN THE FIELD REMOVE AND REINSTALL ACCORDING TO DIAGRAMS BELOW.

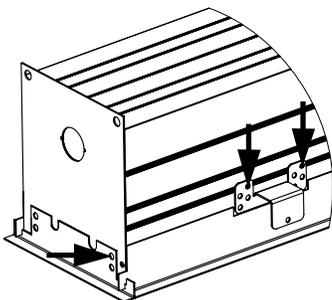


G1: STD 15/16" LAY-IN TILE
G2: STD 9/16" LAY-IN TILE

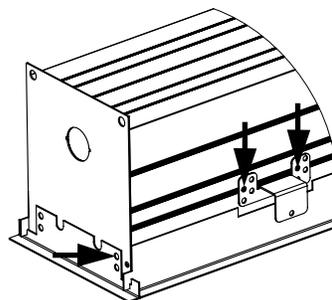

G4: TALL 15/16" LAY-IN TILE
G5: TALL 9/16" LAY-IN TILE

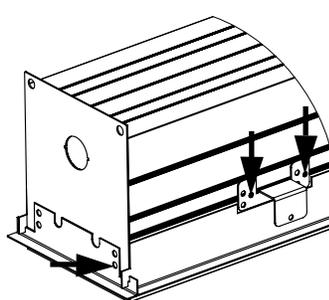

G3: 9/16" SLOT-TEE TEGULAR TILE
T1: STD 15/16" TEGULAR TILE
T2: STD 9/16" TEGULAR TILE
T6: 9/16" NODE TEGULAR TILE

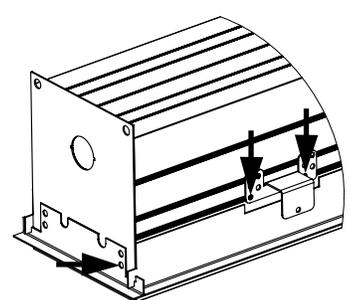


T4: TALL 15/16" TEGULAR TILE
T5: TALL 9/16" TEGULAR TILE



! STD = 1-1/2" TEE HEIGHT, TALL = 1-11/16" TEE HEIGHT

Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation). To prevent electrical shock, disconnect electrical supply before installation or servicing.

CORNER ASSEMBLY





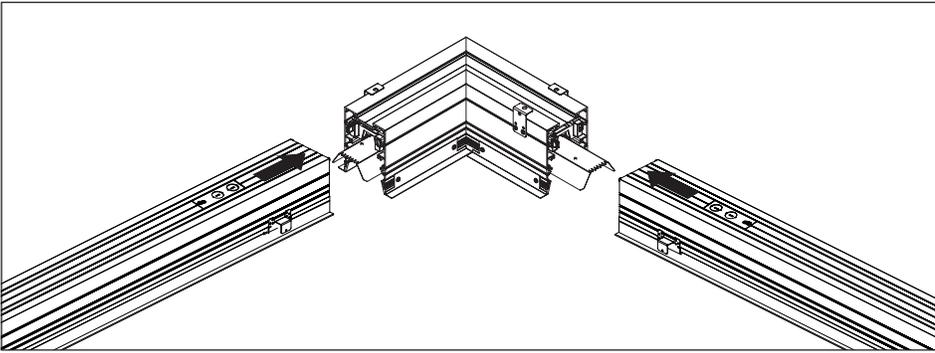


JOINING INSTALLATIONS
SKIP TO STEP 4

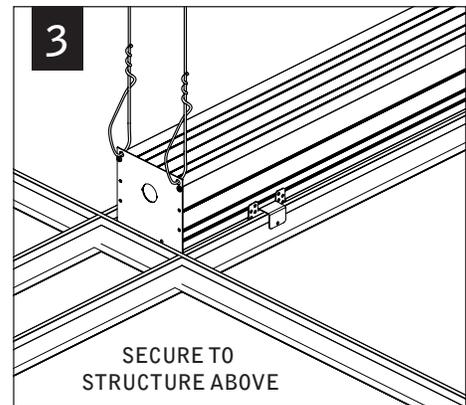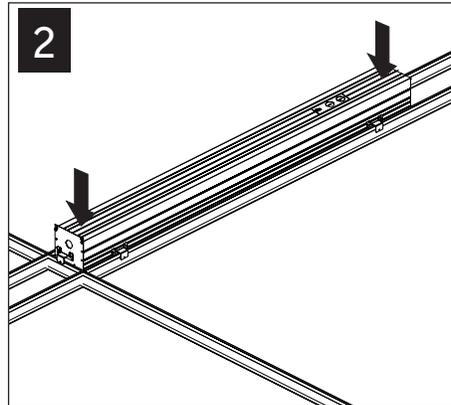


INDIVIDUAL INSTALLATIONS
SKIP TO STEP 8

NOTE: INDIVIDUAL UNITS
CANNOT BE JOINED IN THE FIELD.

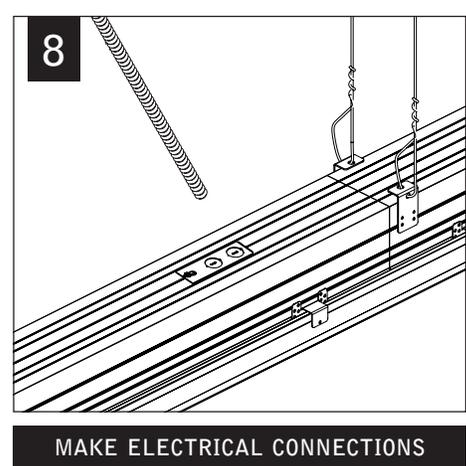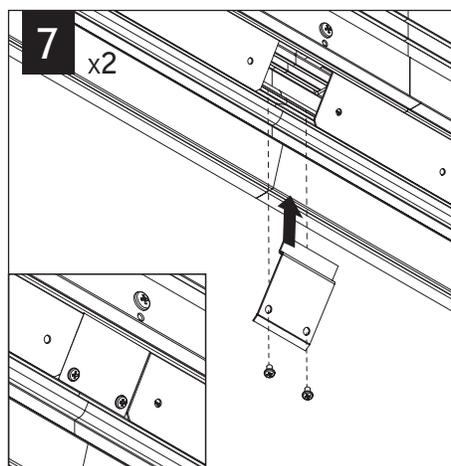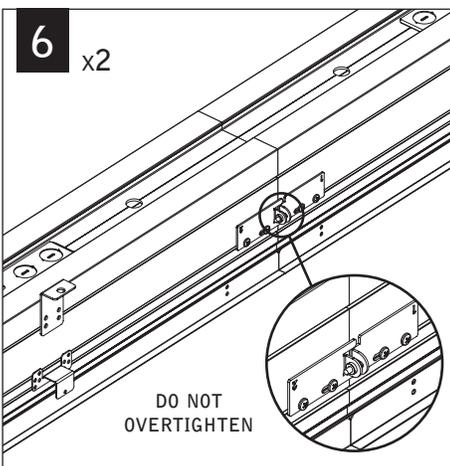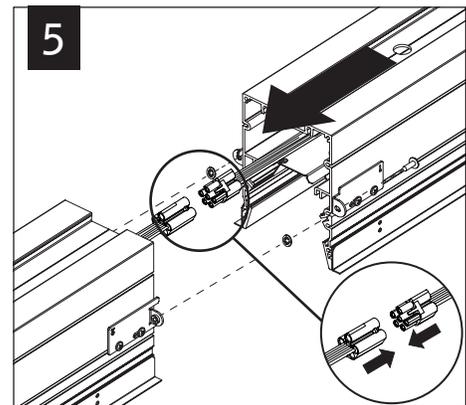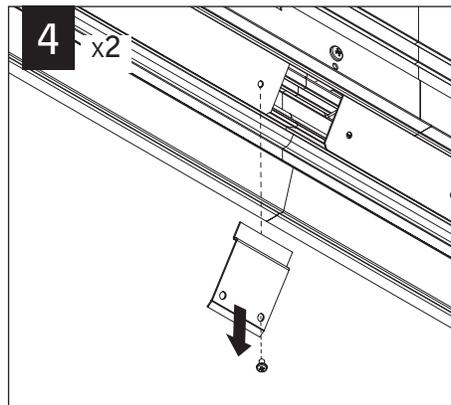




Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
To prevent electrical shock, disconnect electrical supply before installation or servicing.

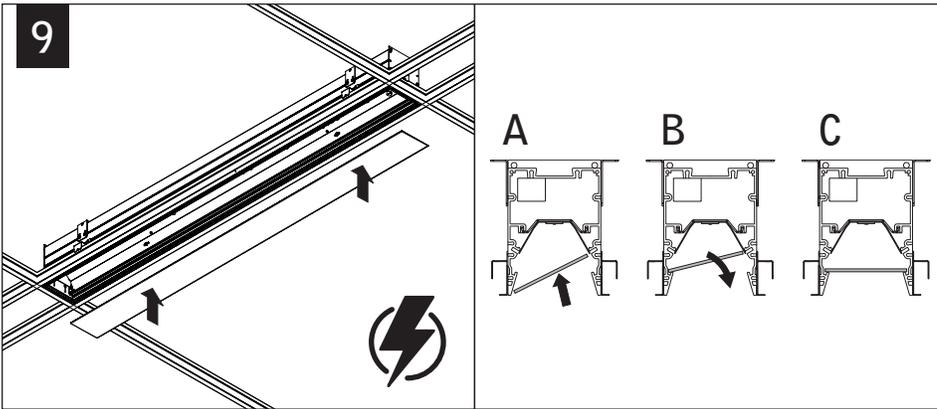

EMERGENCY







SEE BATTERY MANUFACTURER INSTRUCTIONS
 EMERGENCY MAXIMUM MOUNTING HEIGHT:
 13.00'

DRIVER SERVICE

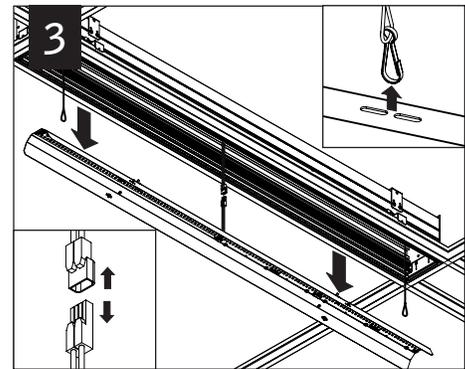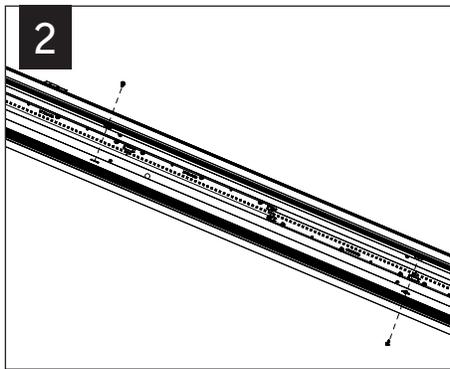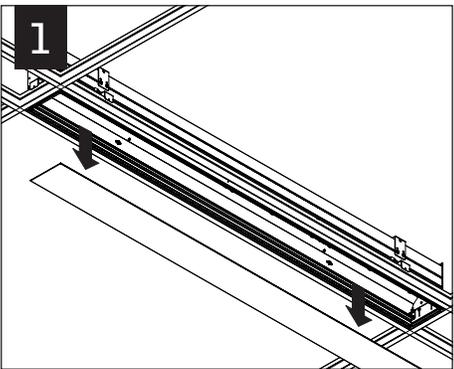

Luminaires must be installed by a qualified electrician (check with local and national codes for proper installation).
 To prevent electrical shock, disconnect electrical supply before installation or servicing.

ACUITY nLIGHT

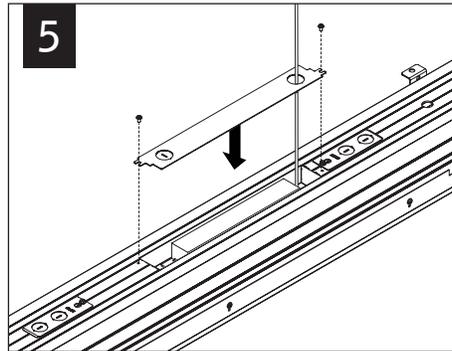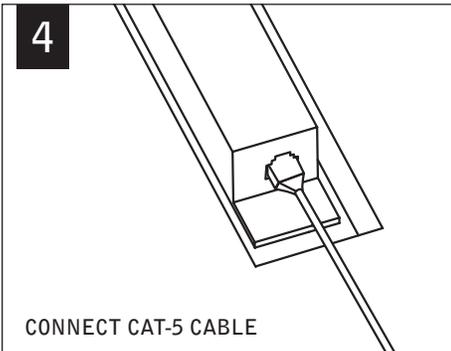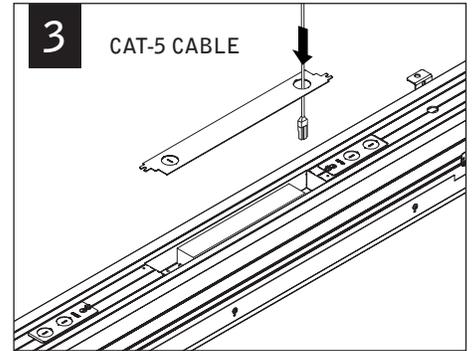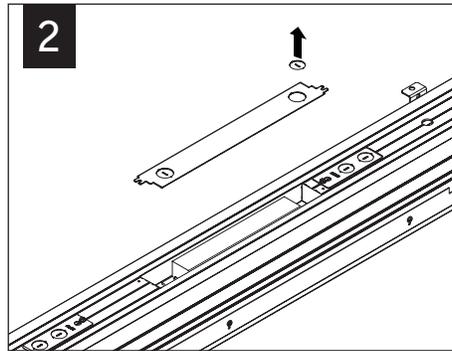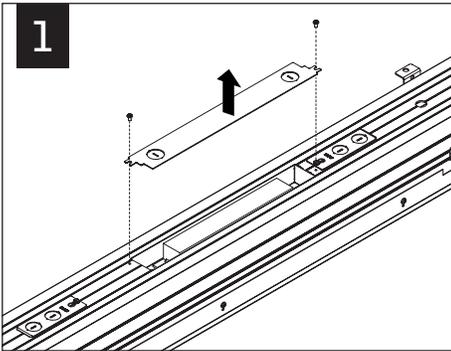

WATTSTOPPER

